

LT-4201TM/4301TM Hardware Manual

The information provided in this documentation contains general descriptions and/or technical characteristics of the performance of the products contained herein. This documentation is not intended as a substitute for and is not to be used for determining suitability or reliability of these products for specific user applications. It is the duty of any such user or integrator to perform the appropriate and complete risk analysis, evaluation and testing of the products with respect to the relevant specific application or use thereof. Neither Pro-face nor any of its affiliates or subsidiaries shall be responsible or liable for misuse of the information that is contained herein. If you have any suggestions for improvements or amendments or have found errors in this publication, please notify us.

No part of this document may be reproduced in any form or by any means, electronic or mechanical, including photocopying, without express written permission of Pro-face.

All pertinent state, regional, and local safety regulations must be observed when installing and using this product. For reasons of safety and to help ensure compliance with documented system data, only the manufacturer should perform repairs to components.

When devices are used for applications with technical safety requirements, the relevant instructions must be followed.

Failure to use Pro-face software or approved software with our hardware products may result in injury, harm, or improper operating results.

Failure to observe this information can result in injury or equipment damage.

Copyright © 2013.12 Digital Electronics Corporation. All Rights Reserved.

Table of Contents



	Safety Information
	About the Book
Part I	LT System
Chapter 1	LT General Overview
•	Package Contents
	Parts Identification and Functions
	System Architecture
	Certifications and Standards
	Devices Overview
Chapter 2	
	Introduction
	Installation Requirements
	Environmental Characteristics
	Wiring Rules and Recommendations
	Wiring to the DIO Terminal Block
	Grounding the System
Chapter 3	LT Description
3.1	Rear Module Features
	Clock
3.2	I/O Management
0.2	Input Management
	Output Management
Chapter 4	Device Connectivity
Chapter 4	System Design
	Interface Accessories
Chapter 5	LT Installation
5.1	Mechanical Requirements
0.1	Dimensions
	Panel Cut-Out Dimensions and Installation
	Installation Procedures
	Mounting Positions
	Mounting Clearances.
	DIN Rail
	Installing and Removing the Rear Module on a DIN Rail
5.2	Electrical Requirements
5.2	
	Power Supply Characteristics and Wiring
	Connecting the Power Supply
F 0	Connecting the Power Supply
5.3	USB Port
	USB Data Transfer Cable - USB Driver Installation
	USB (Type A)
	USB (mini-B)

Part II	LT Unit and Display Modules	
Chapter 6	LT-4201TM/4301TM (Modular Type DIO)	
	Presentation	
	Digital Inputs	
	Digital Outputs	
Chapter 7	LT-4201TM/4301TM (Modular Type Analog)	
	Presentation	
	Digital Inputs	
	Digital Outputs	
	Analog Inputs and Analog Outputs	
Chapter 8	Display Modules	
	Panel Overview	
Part III	LT Controller Panels	
Chapter 9	Communication Interface	
	Ethernet Port	
	CANopen Master Unit	
	Serial Interface (COM1)	
Chapter 10	Specifications	
10.1	General Specifications	
	General Specifications	
10.2	Functional Specifications	
	Display	
	Digital Inputs	
	Digital Outputs	
	Analog Inputs and Analog Outputs	
	Internal Circuits	
	Memory and Touch Panel	
Chapter 11	Maintenance	
•	Regular Cleaning	
	Periodic Check Points	

Safety Information



Important Information

NOTICE

Read these instructions carefully, and look at the equipment to become familiar with the device before trying to install, operate, or maintain it. The following special messages may appear throughout this documentation or on the equipment to warn of potential hazards or to call attention to information that clarifies or simplifies a procedure.



The addition of this symbol to a Danger safety label indicates that an electrical hazard exists, which will result in personal injury if the instructions are not followed.



This is the safety alert symbol. It is used to alert you to potential personal injury hazards. Obey all safety messages that follow this symbol to avoid possible injury or death.

A DANGER

DANGER indicates an imminently hazardous situation which, if not avoided, **will result in** death or serious injury.

WARNING

WARNING indicates a potentially hazardous situation which, if not avoided, **can result in** death or serious injury.

CAUTION

CAUTION indicates a potentially hazardous situation which, if not avoided, **can result in** minor or moderate injury.

NOTICE

NOTICE is used to address practices not related to physical injury.

PLEASE NOTE

Electrical equipment should be installed, operated, serviced, and maintained only by qualified personnel. No responsibility is assumed by Pro-face for any consequences arising out of the use of this material.

A qualified person is one who has skills and knowledge related to the construction and operation of electrical equipment and its installation, and has received safety training to recognize and avoid the hazards involved.

About the Book



At a Glance

Thank you for purchasing Pro-face's LT4000 Series Graphic Logic Controller Interface (Hereafter referred to as the "LT").

Document Scope

The purpose of this document is to:

- Show you how to install and operate your LT.
- Show you how to connect the LT to a programming device equipped with GP-Pro EX.
- Help you understand how to interface the LT and other devices.
- Help you become familiar with the LT features.

Global Code

A global code is assigned to every Pro-face product as a universal model number.

For more information on product models and their matching global codes, please refer to the following URL:

http://www.pro-face.com/product/globalcode.html

Validity Note

This documentation is valid for GP-Pro EX V4.0 or later.

The characteristics presented in this manual should be the same as those that appear online. In line with our policy of constant improvement we may revise content over time to improve clarity and accuracy. In the event that you see a difference between the manual and online information, use the online information as your reference.

Related Documents

Title of Documentation	Reference Number
GP-Pro EX Reference Manual Maintenance/Troubleshooting Guide	
GP-Pro EX Device/PLC Connection Manual	

You can download these technical publications and other technical information from our website "Otasuke Pro!" at http://www.pro-face.com/otasuke/.

Product Related Information

A A DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION OR ARC FLASH

- Disconnect all power from all equipment including connected devices prior to removing any
 covers or doors, or installing or removing any accessories, hardware, cables, or wires except
 under the specific conditions specified in the appropriate hardware guide for this equipment.
- Always use a properly rated voltage sensing device to confirm the power is off where and when
 indicated.
- Replace and secure all covers, accessories, hardware, cables, and wires and confirm that a
 proper ground connection exists before applying power to the unit.
- Use only the specified voltage when operating this equipment and any associated products.

Failure to follow these instructions will result in death or serious injury.

This equipment has been designed to operate outside of any hazardous location. Only install this equipment in zones known to be free of a hazardous atmosphere.

A DANGER

POTENTIAL FOR EXPLOSION

Install and use this equipment in non-hazardous locations only.

Failure to follow these instructions will result in death or serious injury.

A WARNING

LOSS OF CONTROL

- Consider the potential failure modes of control paths in the machine control system design, such as:
 - The possibility of backlight failure.
 - Unanticipated link transmission delays or failures,
 - The operator being unable to control the machine,
 - The operator making errors in the control of the machine.
- Design outside the LT operations such as emergency stop, safety circuits, interlocks that
 operate with opposing actions such as clockwise/counterclockwise rotation, and circuits that
 prevent machine damage with positioning limits on top, bottom, and movement.
- For important operations handled by switches, design your system to use a separate hardware device. This is to reduce the occurrence of incorrect outputs or malfunctions.
- Observe all accident prevention regulations and local safety guidelines.¹
- Test individually and thoroughly each implementation of the equipment for correct operation before service.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

¹ For additional information, refer to NEMA ICS 1.1 (latest edition), "Safety Guidelines for the Application, Installation, and Maintenance of Solid State Control" and to NEMA ICS 7.1 (latest edition), "Safety Standards for Construction and Guide for Selection, Installation and Operation of Adjustable-Speed Drive Systems" or their equivalent governing your particular location.

A WARNING

UNINTENDED EQUIPMENT OPERATION

- Only use software approved by Pro-face for use with this equipment.
- Check your application program every time you change the physical hardware configuration, and make updates as required.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Part I LT System

Overview

This part describes how to use LT system.

What Is in This Part?

This part contains the following chapters:

Chapter	Chapter Name	
1	LT General Overview	13
2	LT System General Implementation Rules	25
3	LT Description	43
4	Device Connectivity	49
5	LT Installation	55

Chapter 1 LT General Overview

Overview

This chapter provides general information about the LT system architecture and its components.

What Is in This Chapter?


This chapter contains the following topics:

Торіс	
Package Contents	
Parts Identification and Functions	
System Architecture	
Certifications and Standards	
Devices Overview	

Package Contents

LT Package Contents


Verify that all items shown in the figure are present in your package:

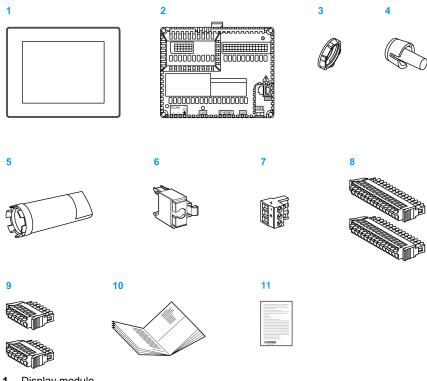

- 1 Display module
- 2 Rear module
- 3 Display installation nut (attached to the display module)
- 4 Anti-rotation tee
- 5 Socket wrench
- 6 USB clamp type A
- 7 DC power supply connector
- 8 I/O connector 15-pin x 2
- 9 I/O connector 6-pin x 2
- 10 LT-4201TM/4301TM Installation Guide
- 11 Warning / Caution information

Display Module Package Contents


Verify that all items shown in the figure are present in your package:



- 1 Display module
- 2 Display installation nut (attached to the display module)
- 3 Anti-rotation tee
- 4 Warning / Caution information

Rear Module Package Contents

Verify that all items shown in the figure are present in your package:

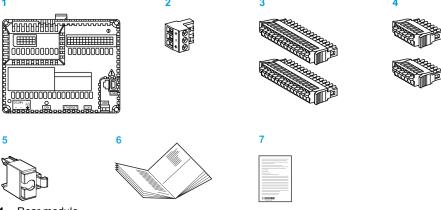

- 1 Rear module
- 2 DC power supply connector
- 3 I/O connector 15-pin x 2
- 4 I/O connector 6-pin x 2
- 5 USB clamp type A
- 6 LT-4201TM/4301TM Installation Guide
- 7 Warning / Caution information

Product Label Sticker

You can identify the product version (PV) and the revision level (RL) from the product label on the panel.


The following diagram is a representation of a typical label:



LT4200/4300 Series model which unit's version number (PV) is 02 or later can also be used as Rear Module.


Parts Identification and Functions

LT-4201TM/4301TM Parts Identification

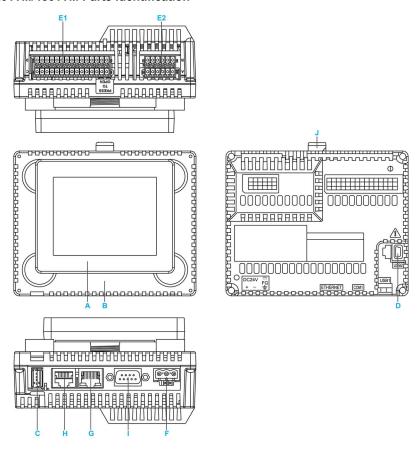

Part	Description
Α	Display module
В	Rear module (see page 89)
С	USB (type A) interface connector (USB1) (see page 82)
D	USB (type mini B) interface connector (USB2)
E1	I/O terminal block 1
E2	I/O terminal block 2
F	DC power supply connector (see page 76)
G	Ethernet interface
Н	Serial link (RS-232C/485) (see page 124)
I	CANopen interface connector
J	Yellow button lock

Rear Module Parts Identification

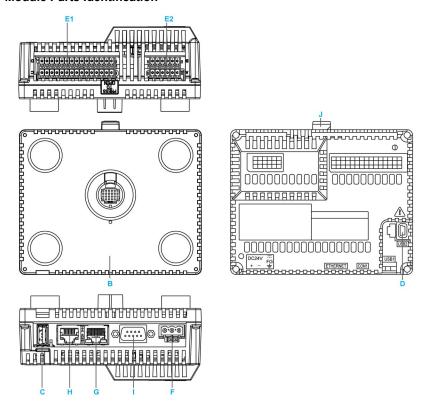

Part	Description
В	Rear module (see page 89)
С	USB (type A) interface connector (USB1) (see page 82)
D	USB (type mini B) interface connector (USB2)
E1	I/O terminal block 1
E2	I/O terminal block 2
F	DC power supply connector (see page 76)
G	Ethernet interface
Н	Serial link (RS-232C/485) (see page 124)
I	CANopen interface connector
J	Yellow button lock


System Architecture

Introduction

The LT system is a compact control system with the Panel and I/O embedded. The LT system offers an all-in-one solution for an optimized configuration and an expandable architecture.

Architecture Example

The following figure provides an example of the LT hardware environment:

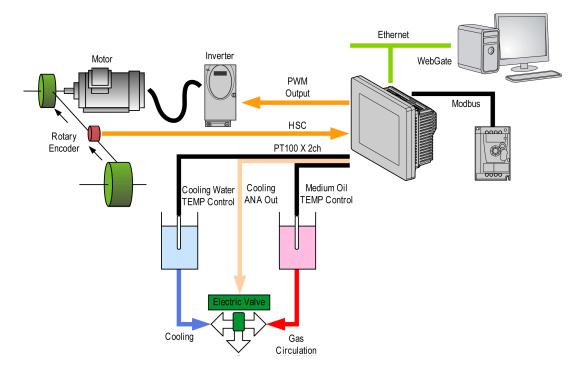


LT System Architecture

Combine the following modules and cables to design a versatile and effective system:

- Rear module that provides the logic and HMI functions
- Display module that provides the display function (see page 111)
- Display module/rear module separation cable that enables you to install the rear and display modules separately.

The figure shows the components of the LT system:

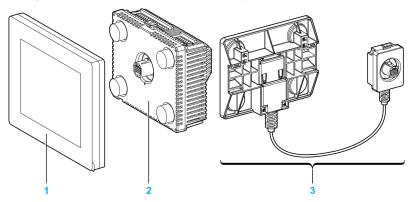

- 1 Display module
- 2 Rear module
- 3 Display module/rear module separation cable

Certifications and Standards

Introduction

Pro-face submitted this product for independent testing and qualification by third party listing agencies. These agencies have certified this product as meeting the following standards.

For information on Standards and Regulations, such as certified models and certificates, see the marking on the product or the following link:

http://www.pro-face.com/worldwide.html or product marking.

Agency Certifications for LT Unit

LT is manufactured in accordance with UL 508 and CSA C22.2 $\rm n^{\circ}$ 142 for Industrial Control Equipment.

For use on a flat surface of a Type 1, Type 4X (indoor use only) enclosure.

Hazardous Substances

This product is a device for use in factory systems. When using this product in a system, the system should comply with the following standards in regards to the installation environment and handling:

- WEEE. Directive 2012/19/EU
- RoHS. Directives 2011/65/EU
- RoHS China, Standard SJ/T 11363-2006
- REACH regulation EC 1907/2006

CE Markings

This product conforms to the necessary requirements of the following Directives for applying the CE label:

- 2006/95/EC Low Voltage Directive
- 2004/108/EC EMC Directive

This conformity is based on compliance with IEC61131-2.

A CAUTION

ENVIRONMENTAL HAZARDS TO THE EQUIPMENT

- Allow the device to reach the surrounding air temperature, not exceeding 50° C (122° F), before turning the device on.
- Do not turn on the device if condensation has occurred inside the device. After it is completely dry again, the device may be turned on.
- Do not expose the device to direct sunlight.
- Do not obstruct the vents in the device casing.
- Remove any dust from the device before turning it on.
- Ensure that the cable installation fasteners are not damaged. Replace them, if necessary.
- Mount the device into an enclosure that meets the IP65 level of protection.

Failure to follow these instructions can result in injury or equipment damage.

A WARNING

RISK OF EXPLOSION IN HAZARDOUS LOCATIONS

- Verify that the power, input, and output (I/O) wiring are in accordance with Class I, Division 2 wiring methods.
- Do not substitute components that may impair compliance to Class I, Division 2.
- Do not connect or disconnect equipment unless power has been switched off or the area is known to be non-hazardous.
- Securely lock externally connected units and each interface before turning on the power supply.
- Do not, connect, or disconnect USB cable unless area is known to be non-hazardous.
- Potential electrostatic charging hazard: wipe the front panel of the terminal with a damp cloth before turning ON.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Interfaces are: COM1, Ethernet, USB1 and USB2.

A WARNING

RISK OF EXPLOSION IN HAZARDOUS LOCATIONS

- Do not disconnect while circuit is live.
- Potential electrostatic charging hazard: wipe the front panel of the terminal with a damp cloth before turning ON.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

KC Markings

해당 무선설비는 운용 중 전파혼신 가능성이 있음

사용자안내문

기 종 별	사 용 자 안 내 문
A급 기기 (업무용 방송통신기자재)	이 기기는 업무용(A급) 전자파적합기기로서 판매자 또는 사용자는 이 점을 주의하시기 바라며, 가정외의 지역에서 사용하는 것을 목적 으로 합니다.

해당 무선설비는 전파혼신 가능성이 있으므로 인명안전과 관련된 서비스는 할 수 없습니다

Devices Overview

Overview

LT has various features. This LT can service a wide range of applications.

The software configuration and programming is accomplished with GP-Pro EX and is described in the GP-Pro EX Reference Manual.

LT Range

Series	Model Names	Models	Digital Input	Digital Output	Analog Input	Analog Output	Screen Size	
LT4000 Series	LT-4201TM (Modular Type DIO)	PFXLM4201TADDC PFXLM4201TADDK	201TADDK Standard Input Output and 2 Points for Fact	Standard SInput (2 Points for Fast SI		None	None	3.5 in.
	LT-4301TM (Modular Type DIO)	PFXLM4301TADDC PFXLM4301TADDK			Fast			5.7 in.
	LT-4000M (Modular Type DIO)	PFXLM4B01DDC PFXLM4B01DDK					None	
	LT-4201TM (Modular Type Analog)	PFXLM4201TADAC PFXLM4201TADAK	12 Points Standard Input (2 Points for Fast Input)	6 Points 2 ch analog Standard inputs (13-bit) analog Output and 2 ch 2 Points Fast (16-bit) for Output Thermocouple 2 ch analog outputs (12-bit)	inputs (13-bit) and 2 ch analog inputs (16-bit) for	analog outputs	3.5 in.	
	LT-4301TM (Modular Type Analog)	PFXLM4301TADAC PFXLM4301TADAK				(12-bit)	5.7 in.	
	LT-4000M (Modular Type Analog)	PFXLM4B01DAC PFXLM4B01DAK					None	
	3.5 inch display module	PFXXM4200TP	None				3.5 in.	
	5.7 inch display module	PFXXM4300TP	None				5.7 in.	

NOTE: Fast Input and Fast Output are generic terms for the following functions:

Fast Input: High-speed Counter Input and Pulse Catch Input.

Fast Output: Pulse Output, PWM Output and High-speed Counter Synchronize Output.

Display Module/Rear Module Separation Cable Range

Reference	Cable Length
PFXZXMADSM31	3 m (9.84 ft.)
PFXZXMADSM51	5 m (14.40 ft.)

 $\label{eq:NOTE:notation} \textbf{NOTE:} \ \ \text{The outer diameter of the cable is 8 mm (0.13 in.). To assemble this product, you need 20 mm (0.78 in.) more space to bend the cable in the end of the rubber.$

Model Name Identification

The table presents the model name identification numbers:

Legend	Number/Letter	er Description			
PFXLM4•0•TAD•• ABCDEFG					
Α	2	LT-4201TM (3.5-inch): QVGA (320 x 240 dots)			
	3	LT-4301TM (5.7-inch): QVGA (320 x 240 dots)			
	В	No display (rear module)			
В	01	RS-232C/RS-485			
С	Т	TFT color LCD			
D	Α	Analog touch panel			
E	D	DC type power supply is used			
F	Α	Analog I/O with Digital I/O			
	D	Digital I/O			
G	С	Source output type			
	К	Sink output type			

Key Features

Programming languages

The LT is supported by and programmed with the GP-Pro EX, which supports the following IEC61131-3 programming languages:

- IL: Instruction List
- LD: Ladder Diagram

Power Supply (see page 75)

The power supply of the LT is 24 Vdc.

Clock (see page 142)

The LT includes a Clock (RTC).

Memory (see page 142)

Embedded Input/Output

The following embedded I/O types are available. The I/O you can use depends on the model in use, see LT Range (see page 22):

- Standard Input
- Fast Input
- Standard Output
- Fast Output
- Analog Input
- Temperature Input
- Analog Output

Communication Interface

- 4 types of communication interfaces are available:
- Ethernet interface
- USB interface
- Serial link interface
- CANopen interface

For more details, refer to the chapter Communication Interface (see page 117).

Chapter 2

LT System General Implementation Rules

Overview

This chapter describes the installation requirements, wiring rules and recommendations, and the environmental specifications of the controller.

What Is in This Chapter?

This chapter contains the following topics:

Торіс	
Introduction	26
Installation Requirements	28
Environmental Characteristics	
Wiring Rules and Recommendations	32
Wiring to the DIO Terminal Block	
Grounding the System	38

Introduction

Before You Begin

A WARNING

UNGUARDED MACHINERY CAN CAUSE SERIOUS INJURY

- Do not use this controller and related software on equipment that does not have point-ofoperation protection.
- Do not reach into machinery during operation.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

The LT controller and related software is used to control various industrial processes. The type or model of automation equipment suitable for each application will vary depending on factors such as the control function required, degree of protection required, production methods, unusual conditions, government regulations, and so on, in some applications, more than one processor may be required, as when backup redundancy is needed.

Only the user can be aware of all the conditions and factors present during the setup, operation, and maintenance of the machine; therefore, only the user can determine the automation equipment and the related safeties and interlocks that can be properly used. When selecting automation and control equipment and related software for a particular application, the user should refer to the applicable local and national standards and regulations.

In some applications, additional operator protection such as point-of-operation guarding must be provided. This is necessary if the operator's hands and other parts of the body are free to enter pinch points or other hazardous areas and serious injury can occur. The LT controller and related software products alone cannot protect an operator from injury. For this reason, this equipment cannot be substituted for or take the place of point-of-operation protection. Ensure that appropriate safeties and mechanical/electrical interlocks related to point of operation protection have been installed and are operational before placing the equipment into service. All interlocks and safeties related to point-of-operation protection must be coordinated with the related automation equipment and software programming.

A WARNING

UNINTENDED EQUIPMENT OPERATION

- Use appropriate safety interlocks where personnel and/or equipment hazards exist.
- Install and operate this equipment in an enclosure appropriately rated for its intended environment.
- Use the sensor and actuator power supplies only for supplying power to the sensors or actuators connected to the module.
- Power line and output circuits must be wired and fused in compliance with local and national regulatory requirements for the rated current and voltage of the particular equipment.
- Do not use this equipment in safety-critical machine functions.
- Do not disassemble, repair, or modify this equipment.
- Do not connect any wiring to unused connections, or to connections designated as Not Connected (N.C.).

Failure to follow these instructions can result in death, serious injury, or equipment damage.

NOTE: Coordination of safeties and mechanical/electrical interlocks for point-of-operation protection is outside the scope of this document, and are not included in any wiring diagrams, installation examples, application examples, programming examples, or other representations that may be included in this and other related documents.

Start-Up and Test

Before using electrical control and automation equipment for regular operation after installation, the system should be given by a start-up test qualified personnel to verify correct operation of the equipment. It is important that the arrangements for such a check be made and that enough time is allowed to perform complete and satisfactory testing.

A CAUTION

EQUIPMENT OPERATION HAZARD

- Verify that all installation and set up procedures have been completed.
- Before operational tests are performed, remove all blocks or other temporary holding means used for shipment from all component devices.
- Remove tools, meters, and debris from equipment.

Failure to follow these instructions can result in injury or equipment damage.

Follow all start-up tests recommended in the equipment documentation. Store all equipment documentation for future references.

Verify that the completed system is free from all short circuits and grounds, except those grounds installed according to local and national regulations. If high-potential voltage testing is necessary, follow recommendations in equipment documentation to help prevent accidental equipment damage or injury.

Before energizing equipment:

- Remove tools, meters, and debris from equipment.
- Close the equipment enclosure door.
- Remove ground from incoming power lines.
- Perform all start-up tests recommended by the manufacturer.

Operation and Adjustments

There are hazards that can be encountered if this equipment is improperly operated or adjusted, regardless of the care exercised in the design and manufacture of equipment or in the selection and ratings of components. It may be possible to mis-adjust this equipment and thereby produce unintended consequences. Only those operational adjustments required by the operator should be accessible to the operator. Access to other controls should be restricted to prevent unauthorized changes in operating characteristics or machine behavior. Restrict access to such adjustments only to qualified personnel familiar with the machinery in use, and familiar with the instructions of equipment manufacturers for all of the electrical equipment employed. Use the instructions from the manufacturers as a guide for functional, electrical, or other like adjustments.

Installation Requirements

Before Starting

Read and understand this chapter before beginning the installation of your LT.

Disconnecting Power

All options and modules should be assembled and installed before installing the control system on a mounting rail, onto a mounting plate or in a panel. Remove the control system from its mounting rail, mounting plate or panel before disassembling the equipment.

A A DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION OR ARC FLASH

- Disconnect all power from all equipment including connected devices prior to removing any
 covers or doors, or installing or removing any accessories, hardware, cables, or wires except
 under the specific conditions specified in the appropriate hardware guide for this equipment.
- Always use a properly rated voltage sensing device to confirm the power is off where and when
 indicated.
- Replace and secure all covers, accessories, hardware, cables, and wires and confirm that a proper ground connection exists before applying power to the unit.
- Use only the specified voltage when operating this equipment and any associated products.

Failure to follow these instructions will result in death or serious injury.

Programming Considerations

A WARNING

UNINTENDED EQUIPMENT OPERATION

- Only use software approved by Pro-face for use with this equipment.
- Check your application program every time you change the physical hardware configuration, and make any updates as required.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Operating Environment

This equipment has been designed to operate outside of any hazardous location. Only install this equipment in zones known to be free of a hazardous atmosphere.

A DANGER

POTENTIAL FOR EXPLOSION

Install and use this equipment in non-hazardous locations only.

Failure to follow these instructions will result in death or serious injury.

A WARNING

UNINTENDED EQUIPMENT OPERATION

- Use appropriate safety interlocks where personnel and/or equipment hazards exist.
- Install and operate this equipment in an enclosure appropriately rated for its intended environment
- Use the sensor and actuator power supplies only for supplying power to the sensors or actuators connected to the module.
- Power line and output circuits must be wired and fused in compliance with local and national regulatory requirements for the rated current and voltage of the particular equipment.
- Do not use this equipment in safety-critical machine functions.
- Do not disassemble, repair, or modify this equipment.
- Do not connect any wiring to unused connections, or to connections designated as Not Connected (N.C.).

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Environmental Characteristics

Enclosure Requirements

LT system components are designed as Zone B, Class A industrial equipment according to IEC/CISPR Publication 11. If they are used in environments other than those described in the standard, or in environments that do not meet the specifications in this manual, the ability to meet electromagnetic compatibility requirements in the presence of conducted and/or radiated interference may be reduced.

All LT system components meet European Community (CE) requirements for open equipment as defined by EN61131-2. You must install them in an enclosure designed for the specific environmental conditions and to minimize the possibility of unintended contact with hazardous voltages. Use a metal enclosure to improve the electromagnetic immunity of your LT system. Use enclosures with a keyed locking mechanism to minimize accidents

Environmental Characteristics

LT meets CE requirements as indicated in the table below, and is intended for use in a Pollution Degree 2 industrial environment.

The table below gives the general environmental characteristics:

Characteristic	Specification	
Standard compliance	IEC61131-2	
Ambient operating temperature for the display and the rear module	Horizontal installation	050° C (32122° F)
	Vertical installation	040° C (32104° F)
Storage temperature		- 2060° C (- 4140° F)
Storage altitude		010,000 m (032,808 ft)
Operating altitude		02,000 m (06,560 ft)
Surrounding Air and Storage Humidity		585% w/o condensation (non-condensing, wet bulb temperature 39° C (102.2° F) or less)
Degree of pollution	IEC60664	2
Degree of protection	IEC61131-2	IP20 with protective covers in place
Corrosive gases		Free of corrosive gases
Dust		⊴0.1 mg/m³ (10 ⁻⁷ oz/ft³) (non-conductive levels)
Atmospheric pressure (Operating Altitude)		8001,114 hPa (2000 m (6,561 ft) or lower)
Vibration resistance	Mounted on a DIN rail	$3.5~\text{mm}$ (0.138 in.) fixed amplitude from 58.4 Hz $9.8~\text{m/s}^2$ (1 g_n) fixed acceleration from 8.4150 Hz
	Mounted on a panel	3.5 mm (0.138 in.) fixed amplitude from 58.6 Hz 9.8 m/s ² (1 g _n) fixed acceleration from 8.6150 Hz
Mechanical shock resistance	Mounted on a DIN rail	147 m/s ² (15 g _n) for a duration of 11 ms
	Mounted on a panel	147 m/s ² (15 g _n) for a duration of 6 ms

Electromagnetic Susceptibility

The LT system meets electromagnetic susceptibility specifications as indicated in the table:

Characteristic	Specification	Range
Electrostatic discharge	IEC/EN 61000-4-2	8 kV (air discharge) 6 kV (contact discharge)
Radiated radio frequency electromagnetic fields	IEC/EN 61000-4-3	10 V/m (80 MHz3 GHz)
Fast transients / Burst noise	IEC/EN 61000-4-4	Power lines: 2 kV Digital I/O: 1 kV Relay outputs: 2 kV Ethernet line: 1 kV COM line: 1 kV CAN line: 1 kV
Surge immunity	IEC/EN 61000-4-5	Power supply: CM: 1 kV; DM: 0.5 kV Digital I/O: CM: 1 kV; DM: 0.5 kV Shielded cable: 1 kV CM = common drive DM = differential drive
Conducted disturbances induced by radio- frequency fields	IEC/EN 61000-4-6	10 Veff (0.1580 MHz)
Mains terminal disturbance	EN 55011 (IEC/CISPR11)	150500 kHz, quasi peak 79 dBμV
voltage		500 kHz30 MHz, quasi peak 73 dBµV
Electric field strength	EN 55011 (IEC/CISPR11)	30230 MHz, quasi peak 10 m@40 dBμV/m
		230 MHz1 GHz, quasi peak 10 m@47 dBμV/m

Wiring Rules and Recommendations

Introduction

There are several rules that must be followed when wiring the LT system.

Wiring Guidelines

A A DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION OR ARC FLASH

- Disconnect all power from all equipment including connected devices prior to removing any covers or doors, or installing or removing any accessories, hardware, cables, or wires except under the specific conditions specified in the appropriate hardware guide for this equipment.
- Always use a properly rated voltage sensing device to confirm the power is off where and when
 indicated.
- Replace and secure all covers, accessories, hardware, cables, and wires and confirm that a
 proper ground connection exists before applying power to the unit.
- Use only the specified voltage when operating this equipment and any associated products.

Failure to follow these instructions will result in death or serious injury.

The following rules must be applied when wiring a LT system:

- I/O and communication wiring must be kept separate from the power wiring. Route these 2 types
 of wiring in separate cable ducting.
- Verify that the operating conditions and environment are within specification.
- Use proper wire sizes to meet voltage and current requirements.
- Use copper conductors.
- Use twisted-pair, shielded cables for analog, and/or fast I/O.
- Use twisted-pair, shielded cables for networks, and fieldbus.
- For the power connector, refer to DC power supply wiring diagram (see page 77).
- When terminals A2 and B2 (signal name: Q1, Q0) are wired to external I/O, use the same power source for external I/O and the LT. Refer to Power Supply Connections.
- If you use a temperature sensor with thermocouple inputs, make sure you use the compensation cable.
- Prevent temperature changes to the thermocouple connection terminal. Correct temperature
 measurement may not be possible if the thermocouple cold junction (LT's thermocouple
 compensation wiring to the connection terminal) experiences temperature changes.

A WARNING

IMPROPER GROUNDING CAN CAUSE UNINTENDED EQUIPMENT OPERATION

- Use cables with insulated shielded jackets for analog I/O, fast I/O and communication signals.
- Ground shielded cables for analog I/O, fast I/O and communication signals at a single point 1.
- Always comply with local wiring requirements regarding grounding of cable shields.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

¹Multipoint grounding is permissible if connections are made to an equipotential ground plane dimensioned to help avoid shielded cable damage in the event of power system short circuit currents.

For more details, refer to Grounding Shielded Cables (see page 38).

The wire sizes to use with the removable terminal blocks is 0.20 to 0.81 mm² (AWG 24 to 18).

A DANGER

FIRE HAZARD

Use only the recommended wire sizes for I/O channels and power supplies.

Failure to follow these instructions will result in death or serious injury.

Terminal Block

Not plugging the terminal block into rear module correctly can cause an electric shock or unintended operation of the application and/or can damage the rear module.

▲ DANGER

UNINTENDED EQUIPMENT OPERATION OR ELECTRIC SHOCK

Be sure to connect the terminal blocks to their designated location.


Failure to follow these instructions will result in death or serious injury.

NOTE: When installing the terminal blocks to the rear module, please keep the display module unmounted.

NOTE: To help prevent a terminal block from being inserted incorrectly, clearly and uniquely code and label each terminal block and rear module.

Avoid temperature changes on the thermocouple's connection terminal. Temperature measurements may not be accurate due to temperature changes in the cold junction (LT connection terminal for the thermocouple compensation cable).

The figure shows the labels on each terminal block:

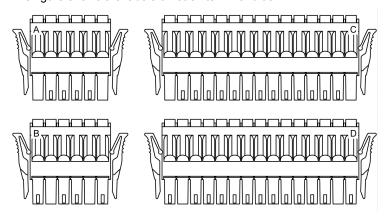

NOTE: Appearance of the connectors are the same but are different. Check the label and pin position of each connector before connecting.

Protecting Outputs from Inductive Load Damage

Depending on the load, a protection circuit may be needed for the outputs on the controllers and certain modules. Inductive loads using DC voltages may create voltage reflections resulting in overshoot that will damage or shorten the life of output devices.


A CAUTION

OUTPUT CIRCUIT DAMAGE DUE TO INDUCTIVE LOADS


Use an appropriate external protective circuit or device to reduce the risk of inductive direct current load damage.

Failure to follow these instructions can result in injury or equipment damage.

Protective circuit A: this protection circuit can be used for DC load power circuits and source outputs (positive logic).




Protective circuit A: this protection circuit can be used for DC load power circuits and sink outputs (negative logic).




- C represents a value from 0.1 to 1 μF.
- R represents a resistor of approximately the same resistance value as the load.

Protective circuit B: this protection circuit can be used for DC load power circuits and source outputs (positive logic).




Protective circuit B: this protection circuit can be used for DC load power circuits and sink outputs (negative logic).




Use a diode with the following ratings:

- Reverse withstand voltage: power voltage of the load circuit x 10.
- Forward current: more than the load current.

Protective circuit C: this protection circuit can be used for DC load power circuits and source outputs (positive logic).



Protective circuit C: this protection circuit can be used for DC load power circuits and sink outputs (negative logic).



In applications where the inductive load is switched on and off frequently and/or rapidly, ensure
that the continuous energy rating (J) of the varistor exceeds the peak load energy by 20% or
more.

Wiring to the DIO Terminal Block

Introduction

Wiring Rules and Recommendations.

A CAUTION

EQUIPMENT DAMAGE

Be sure to remove the terminal blocks from the equipment prior to wiring.

Failure to follow these instructions can result in injury or equipment damage.

Screwdriver Required to Wire Terminal Blocks

Recommended type: 1891348-1 (Tyco Electronics AMP)

If another manufacturer is used, be sure the part has the following dimensions:

• point depth: 1.5 mm (0.06 in.)

• point height: 2.4 mm (0.09 in.)


Point shape must be DIN5264A and meet standard DN EN60900.

Also, the screwdriver tip must be flat, as indicated, to access the narrow hole of the terminal block:



The terminal blocks are a spring clamp type.

Procedure



Use the following procedure to connect the wires to the terminal blocks:

Step	Action
1	Insert the screwdriver into the square-shaped hole. This will open the wire's round-shaped hole.
2	Hold the screwdriver and insert the wire into the wire's round-shaped hole.
3	Take out the screwdriver from the square-shaped hole. The round-shaped hole will then close, and the wire will be held securely in place.

NOTE: To remove the wire, reinsert the screwdriver into the square-shaped hole and when the wire's spring clamp releases, pull out the wire.

- (1) Wire should be 0.20...0.81 mm² (AWG 24...18), with the end twisted. Applicable wire style are UL1015 and UL1007.
- (2) Strip 7.0 mm (0.28 in) of jacket from the wire. Strip only the amount of jacket required. If too much jacket is removed, the ends may short against each other or against the terminals, which can create an electric short. If not enough jacket is removed, the wire may not make sufficient contact with the terminal.

Insert each wire completely into its opening. Improper insertion can lead to a loss of unit power or short circuit, either against the wire filaments or against the terminals, or to over heating of the wire and terminal.

(3) Do not rotate the point of the screwdriver inside the square-shaped opening. It may damage the equipment.

A WARNING

IMPROPER WIRING PRACTICES CAN MAKE EQUIPMENT INOPERABLE

- Use only the specified wire sizes for I/O channels and power supplies.
- Prepare wires and make connections as specified in this documentation.
- Do not connect more than one wire per terminal block connector.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Grounding the System

Overview

To minimize the effects of electromagnetic interference, cables carrying the fast I/O, analog I/O, and Serial communication signals must be shielded.

A WARNING

IMPROPER GROUNDING CAN CAUSE UNINTENDED EQUIPMENT OPERATION

- Use cables with insulated shielded jackets for analog I/O, fast I/O and communication signals.
- Ground shielded cables for analog I/O, fast I/O and communication signals at a single point 1.
- Always comply with local wiring requirements regarding grounding of cable shields.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

¹To avoid damage to the shielded cable when there is a short circuit in the power line, set up a multi-point frame ground (FG) each with the same electric potential.

The use of shielded cables requires compliance with the following wiring rules:

- When there is no protective earth ground, you can use metal conduit or cable duct shield as a
 part of the protective earth ground. The functional ground (FE) shield must attenuate
 electromagnetic interference and must be shielded the length of the cable. If the purpose is for
 both functional and protective grounding, as is often the case for communication cables, the
 cable must have continuous shielding.
- Wherever possible, keep cables carrying one type of signal separate from the cables carrying other types of signals or power.

Protective Earth Ground on the Backplane

For protective grounding, connect braided copper cable (that can withstand the maximum voltage/current allowed by the system) to the conductive backplane.

Functional Ground on the DIN Rail

The DIN rail for your LT is common with the functional ground plane and must be mounted on a conductive backplane.

WARNING

UNINTENDED EQUIPMENT OPERATION

When connecting DIN rails, connect the DIN rails to functional ground (FE).

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Shielded Cables Connections

Cables carrying the fast I/O, analog I/O, and Serial communication signals must be shielded. The shielding must be securely connected to ground. The fast I/O and analog I/O shields may be connected either to the functional ground (FE) or to the protective earth ground (PE) of your LT.

A WARNING

ACCIDENTAL DISCONNECTION FROM PROTECTIVE GROUND (PE)

- Do not use the grounding bar to provide a protective earth ground (PE).
- Use the grounding bar only to provide a functional ground (FE).

Failure to follow these instructions can result in death, serious injury, or equipment damage.

A DANGER

HAZARD OF ELECTRIC SHOCK


Make sure that CANopen and Modbus cables are securely connected to the protective earth ground (PE).

Failure to follow these instructions will result in death or serious injury.

NOTE: The functional ground of the Ethernet connection is internal.

Protective Earth Ground (PE) Cable Shielding

The following shows the steps when using shield cables for grounding the LT power supply, Standard I/O, High-speed I/O, Analog I/O, Temperature Input, Communication cable so on.

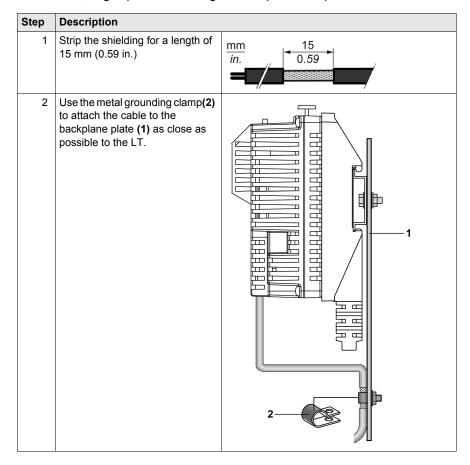

NOTE: The shielding must be clamped securely to the conductive backplane to ensure a good contact.

Exclusive Grounding

Connect the frame ground (FG) terminal on the power plug to an exclusive ground. When supplying power to the LT unit, be sure to separate the input, output and power lines, as shown:




Common Grounding

If exclusive grounding is not possible, use a common grounding point. Use grounding resistance of 10 Ω or less, wire thickness of 2.6 mm or more, or your country's applicable standard for the grounding point.

Precautions:

- Do not use common grounding, since it can lead to accidents and machine breakdown.
- If the equipment does not function properly when grounded, disconnect the ground wire from the FG terminal.



Grounding Procedure

Step	Action
1	Check that the grounding resistance is less than 100 Ω (Grounding resistance of 100 Ω or less, wire thickness of 1.6 mm or more, or your country's applicable standard.)
2	Create the connection point as close to the unit as possible, and make the wire as short as possible. When using a long grounding wire, replace the thin wire with a thicker wire, and place it in a duct.

NOTE: FG and SG terminals are internally connected in the LT. When connecting an external device to the LT using the SG terminal, be sure to check that no short-circuit loop is created when you setup the system.

Chapter 3 LT Description

Overview

This chapter describes the LT features.

What Is in This Chapter?

This chapter contains the following sections:

Section	Торіс	Page
3.1	Rear Module Features	44
3.2	I/O Management	45

Section 3.1

Rear Module Features

Clock

Overview

The LT has a clock.

Variations in operating conditions can cause a clock shift:

Ambient Temperature	Accuracy (30 days deviation)
0°C (32 °F)	-2.52.5 minutes
25°C (77°F)	-2.52.5 minutes
50°C (122 °F)	-5.52.5 minutes

Battery for Clock

The controller has one battery for the clock.

In the event of a power interruption, the backup battery retains the time and date for the controller.

The table describes the characteristics of the battery:

Use	In the event of a transient power outage, the battery powers the clock.
Duration of backup	At least 5 years at 25 °C max (77 °F). At higher temperatures, the duration of backup is reduced.

NOTE: Do not replace the LT unit's battery yourself. The LT uses a lithium battery for backing up its internal clock data and the battery may explode if it is replaced incorrectly. When replacement is required, please contact your local LT distributor.

Section 3.2 I/O Management

What Is in This Section?

This section contains the following topics:

Торіс	Page
Input Management	46
Output Management	47

Input Management

Overview


LT is equipped with Standard Inputs and Fast Inputs. You can manage the input values using the software filter function that eliminates the input signal noise.

This section explains the filter concept using Fast Input as an example. High-speed Counter Input and Pulse Catch Input can be managed as Special Input and Output.

Filter Principle of Special I/O

The filter is designed to reduce the bouncing effect at the inputs. Setting a filter value allows the controller to ignore sudden changes of input levels caused by noise.

The following timing diagram illustrates the filter effects:

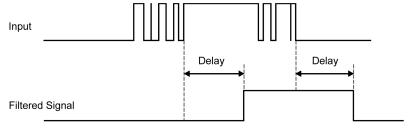

Output Management

Introduction

The LT Unit includes Standard outputs and fast outputs.

The following output functions are configurable on fast outputs:

- PWM output
- Pulse output
- High-speed Counter (Synchronize Output)

Fast Output Management Availability

The information refers to all LT with fast outputs:

Output Terminal	Function
Q0	Pulse Output/CH 0, PWM Output/CH 0, High-speed Counter (Synchronize Output)/CH 0
Q1	Pulse Output/CH 1, PWM Output/CH 1 High-speed Counter (Synchronize Output)/CH 1

Short-circuit or Over-Current on Outputs

There are two groups for the output's short circuit and over-current.

Group 1 (Fast Output) has a short-circuit protection circuit between the output and V-. Group 2 (Standard Output) does not have this circuit.

LT-4201TM (Modular Type DIO) and LT-4301TM (Modular Type DIO):

- Group 1: 2 points Fast Outputs (Q0 to Q1)
- Group 2: 10 points Standard Outputs (Q2 to Q11)

LT-4201TM (Modular Type Analog) and LT-4301TM (Modular Type Analog):

- Group 1: 2 points Fast Outputs (Q0 to Q1)
- Group 2: 6 points Standard Outputs (Q2 to Q7)

The table describes the errors:

If	then
you have a short-circuit at 0 V on Fast Output	Fast Output is stopped and error message is generated.
you have a short-circuit at 24 V on Fast Output	For more details, refer to the GP-Pro EX Reference Manual.
the current crossing the Fast Output is too high	wartan.

For more information on protecting outputs, refer to your controller wiring diagram and to the general wiring rules (see page 32).

The Standard outputs of this equipment do not have built-in reverse polarity protection. Incorrectly connecting polarity can permanently damage the output circuits or otherwise result in unintended operation of the equipment.

NOTICE

DAMAGE TO FAST OUTPUTS

- Ensure the use of adequate protection against short-circuits on the power supply to the fast outputs.
- Do not connect positive voltage to any of the DC fast outputs terminals.

Failure to follow these instructions can result in equipment damage.

A WARNING

UNINTENDED MACHINE START-UP

Inhibit the automatic rearming of outputs if this feature is an undesirable behavior for your machine or process.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Wiring Considerations

NOTE: Turn on the power of LT before turning on the power of external I/O. Otherwise, the wrong signal for Pulse Output, PWM Output and High-speed Counter (Synchronize Output) is output.

A WARNING

UNINTENDED EQUIPMENT OPERATION

Be sure to wire the outputs correctly according to the wiring diagram.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Chapter 4

Device Connectivity

Introduction

This chapter presents the equipment you can connect to the LT panel.

What Is in This Chapter?

This chapter contains the following topics:


Торіс	Page
System Design	50
Interface Accessories	53

System Design


Introduction

The following diagrams represent the main selection of equipment you can connect to the panels.


Edit Mode Peripherals

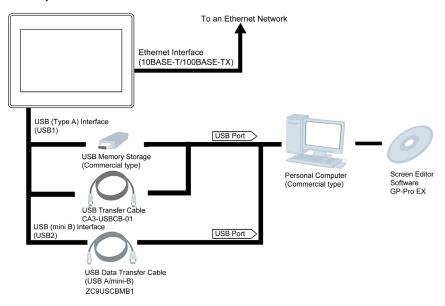

Run Mode Peripherals - USB Type A/Mini B Interface

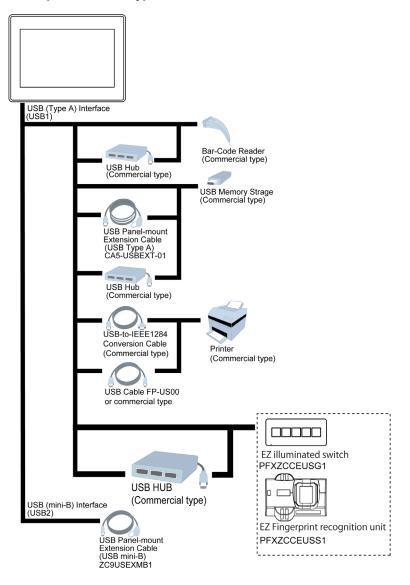

Run Mode Peripherals - Serial Communication and Ethernet Communication

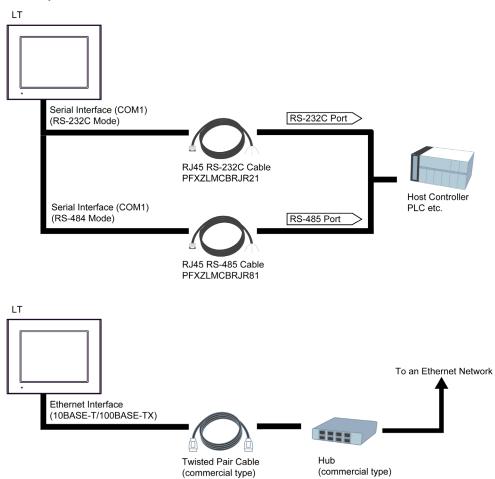

Interface Accessories

Serial Interface Items

Reference Name	Reference Number	Description
RJ45 RS-232C Cable (5m)	PFXZLMCBRJR21	Cable with loose wires at one end for RS-232C connection between various hosts and the LT
RJ45 RS-485 Cable (5m)	PFXZLMCBRJR81	Cable with loose wires at one end for RS-485 connection between various hosts and the LT

USB Host Interface

Reference Name	Reference Number	Description
USB Transfer Cable (2 m)	CA3 USBCB-01	Download project data created with the Screen Editor and Logic Program Software via the LT unit's USB I/F.
USB Cable (5 m)	FP-US00	Connects a USB printer (type B)
USB Front Cable (1 m)	CA5 USBEXT-01	Extension cable that attaches to USB (mini B) port of the LT
USB Transfer Cable (USB A/mini B) (1.8 m)	ZC9USCBMB1	Cable for transferring screen data from the PC (USB type A) to LT (USB mini B)
USB Panel-Mount Extension Cable (USB mini B) (1 m)	ZC9USEXMB1	Extension cable that attaches to USB (mini B) port of the LT
EZ Illuminated Switch	PFXZCCEUSG1	A unit of 5 illuminated switches with multiple color LED easily connected with LT via USB
EZ Fingerprint Recognition Unit	PFXZCCEUSS1	Fingerprint recognition unit easily connected with LT via USB
EZ Numpad	PFXZCCEUKB1	Numpad easily connected with LT via USB

Software

Reference Name	Description
GP-Pro EX	GP-Pro EX is screen editing & logic programming software made by Digital Electronics Corporation. You can edit screens with simple operations.

Maintenance Options

Reference Name	Reference Number	Description
Installation Nut	PFXZGMNT1	Nut to install the display module (10 pcs/set).
Socket Wrench	PFXZGMSW1	Socket wrench to tighten and loosen the display installation nut.
Accessories Kit	PFXZGMAK1	Anti-rotation tee, USB cable clamp to prevent disconnection (Type A, mini-B, for 1 port), 2 mm-high spacer to adjust installation panel thickness (1pcs/each).
DC Power Supply Connector	PFXZGMCNDC1	Connector to connect DC power supply cable (5 pcs/set).
DIO Connector for LT4000M	PFXZLMCNIO1	15-pin I/O connector (Connector A x 1, Connector B x 1) and 6-pin I/O connector (Connector C x 1, Connector D x 1). NOTE: Connector A and B are different and connector C and D are different.

Options Items

Reference Name	Reference Number	Description
	LT-4201TM: CA6-DFS4-01	Disposable, dirt-resistant sheet for the unit'
Sheet	LT-4301TM: PFXZCBDS61	screen (5 sheet/set) (hard type).

CANopen Cables and Connectors Parts

	Reference Number	Manufacturer	Description
Recommended Cable Connector	XM2D-0901	OMRON Co.	DSUB 9-pin socket
	TSXCANKCDF180T	Schneider Electric	Straight connector with terminal selector switch.
	VS-09-BU-DSUB/CAN	PHOENIX CONTACT	Connector with terminal block and terminal selector switch
	SUBCON-PLUS-CAN/AX	PHOENIX CONTACT	Straight connector with terminal selector switch
CANopen Recommended Transfer Cable	TSXCAN CA50 TSXCAN CA100	Schneider Electric	Cable for CANopen (IEC60332-1) 50 m/100 m.
	TSXCAN CB50 TSXCAN CB100	Schneider Electric	UL-approved cable for CANopen (IEC60332-2) 50 m/100 m.

Chapter 5 LT Installation

Overview

This chapter provides installation safety guidelines, device dimensions, mounting instructions, and environmental specifications.

What Is in This Chapter?

This chapter contains the following sections:

Section	Торіс	Page
5.1	Mechanical Requirements	56
5.2	Electrical Requirements	75
5.3	USB Port	82

Section 5.1

Mechanical Requirements


What Is in This Section?

This section contains the following topics:


Торіс	Page
Dimensions	57
Panel Cut-Out Dimensions and Installation	61
Installation Procedures	64
Mounting Positions	69
Mounting Clearances	
DIN Rail	72
Installing and Removing the Rear Module on a DIN Rail	

Dimensions


3.5 Inches Display Module

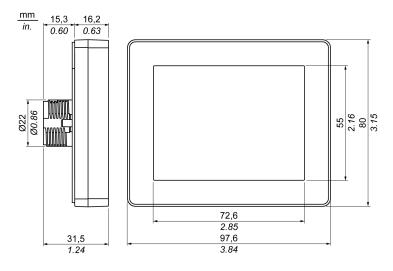


5.7 Inches Display Module

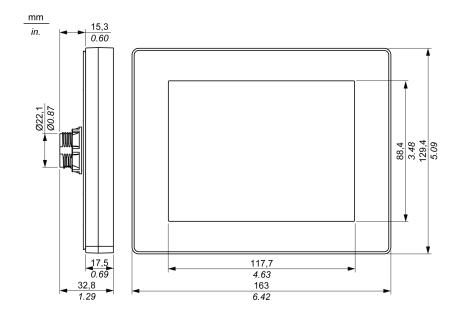


Rear Module

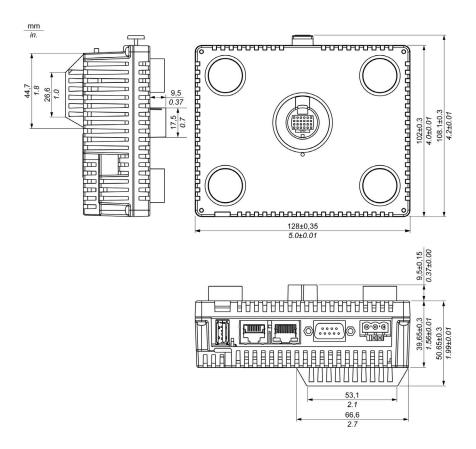


3.5 Inches Display Module and Rear Module

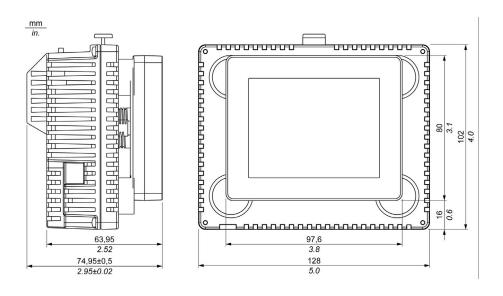


5.7 Inches Display Module and Rear Module





Display Module/Rear Module Separation Cable

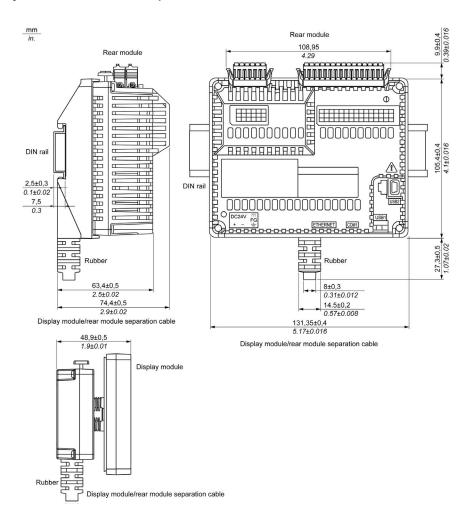

NOTE:

Use this display module/rear module separation cable when the rear module is installed on the rail:


- The outer diameter of the cable is 8 mm (0.31 in.).
- There are 2 types of cable: 3 m (9.84 ft) and 5 m (16.4 ft).
- To assemble this product, you need 20 mm (0.78 in.) more space to bend the cable in the end
 of the rubber.

Panel Cut-Out Dimensions and Installation

Inserting a Display Module Without an Anti-Rotation Tee

Create a panel cut-out and insert the display module into the panel from the front.

The figure shows the panel cut-out:

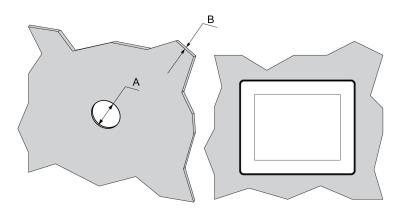

Dimensions


Α	B (1)	B (2)
22.50 ^{0/-0.30} mm (0.88 ^{0/-0.01} in.)	1.56 mm (0.060.23 in.)	36 mm (0.110.23 in.)
(1) Steel sheet(2) Glass fiber reinforced plastics (minimum GF30)		

NOTE: Without the tee option, the display module supports a rotating torque of 2.5 N•m (22.12 lb-in).

Inserting a Display Module With an Anti-Rotation Tee

Create a panel cut-out and insert the display module into the panel from the front.

The figure shows the panel cut-out for a LT Unit using a tee:

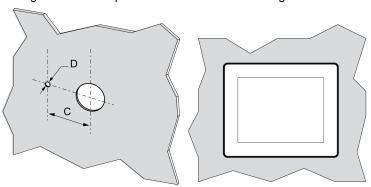


Dimensions

С	D
30 ^{0/-0.20} mm	4 ^{0/-0.20} mm
(1.18 ^{0/-0.0007} in.)	(0.15 ^{0/-0.007} in.)

NOTE: With the tee option, the display module supports a rotating torque of 6 N•m (53.10 lb-in).

Installing the LT Display

The figure shows the assembly:

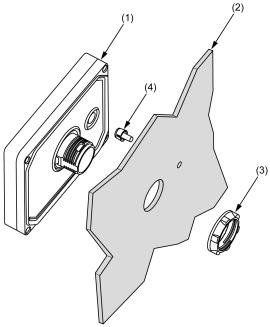


- (1) Display module
- (2) Panel
- (3) Display installation nut
- (4) Anti-rotation tee

Installing the LT Display Module with Spacer

The spacer supplied in the accessory kit PFXZGMAK1 (sold separately), allows mounting the product on a:

- steel sheet support with a thickness between 1 and 1.5 mm (0.039 in. and 0.059 in.)
- plastic support with a thickness between 1 and 3 mm (0.039 in. and 0.118 in.)
- glass fiber reinforced plastic with a thickness between 2 and 3 mm (0.078 in. and 0.118 in.)

The figure shows the assembly with the Panel spacer:

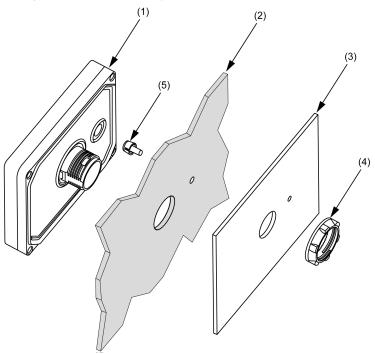

- (1) Display module
- (2) Panel
- (3) Spacer
- (4) Display installation nut
- (5) Anti-rotation tee

Installation Procedures

Installing the LT Unit

In order to correctly run an application on the LT, both the display module and the rear module must be connected.

A WARNING

EXPLOSION HAZARD


- Do not connect or disconnect while circuit is live.
- Potential electrostatic charging hazard: wipe the front panel of the terminal with a damp cloth before turning ON.

Failure to follow these instructions can result in death, serious injury, or equipment damage.


If you power up the rear module without connecting the display module, the logic controller does not start and all outputs remain in the initial state. The power must be off before connecting the modules.

There are 2 ways to install the LT.

Installing the LT on the panel:

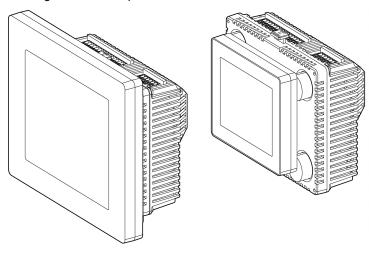

Installing the rear module on a DIN rail with a display module/rear module separation cable:

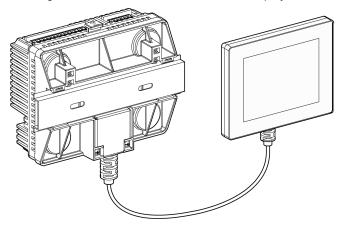


LT Setup Procedure

Mount the unit in an enclosure that provides a clean, dry, robust, and controlled environment (IP65 enclosure or UL508 4x, if indoors).


Before installing the LT verify that:

- The installation panel or cabinet surface is flat (planarity tolerance: 0.5 mm (0.019 in.)), in good condition and has no jagged edges. Metal reinforcing strips may be attached to the inside of the panel, near the panel cut-out, to increase the rigidity.
- The panel is designed to avoid any induced vibration resonance on the rear module exceeding a punctual factor of 10 and avoids any induced permanent vibration resonance.
 To reduce the resonance use the panel adaptor accessory.
- The ambient operating temperature and the ambient humidity are within their specified ranges.
 (When installing the panel in a cabinet or enclosure, the ambient operation temperature is the internal temperature of the cabinet or enclosure).
- The heat from surrounding equipment does not cause the unit to exceed its specified operating temperature.
- When installing the display module in a vertical position (portrait view), the logo on the display face must be on the right side to keep the power connector at the top:




NOTE: For use in Pollution Degree 2 environments.


• The panel face is not inclined more than 30° when installing the unit in a slanted panel:

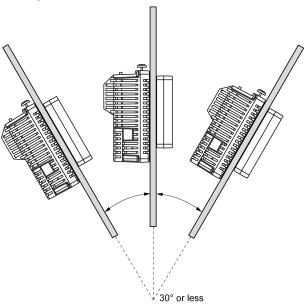


- The power plug is positioned vertically when the unit is vertically installed.
- The unit is at least 100 mm (3.94 in.) away from adjacent structures and other equipment for easier maintenance, operation, and improved ventilation:


mm in.





Step	Action
1	Place the unit on a clean and level surface with the display panel facing downward.
2	The support thickness depends on the material: Steel sheet: between 1.5 and 6 mm (0.059 in. and 0.236 in.) Plastic: between 3 and 6 mm (0.118 in. and 0.236 in.)
	If the thickness is between 1 and 1.5 mm (0.039 in. and 0.059 in.) for a steel sheet support or between 1 mm and 3 mm (0.039 in. and 0.118 in.) for plastic, use the spacer adaptor supplied in accessory kit PFXZGMAK1 (sold separately).

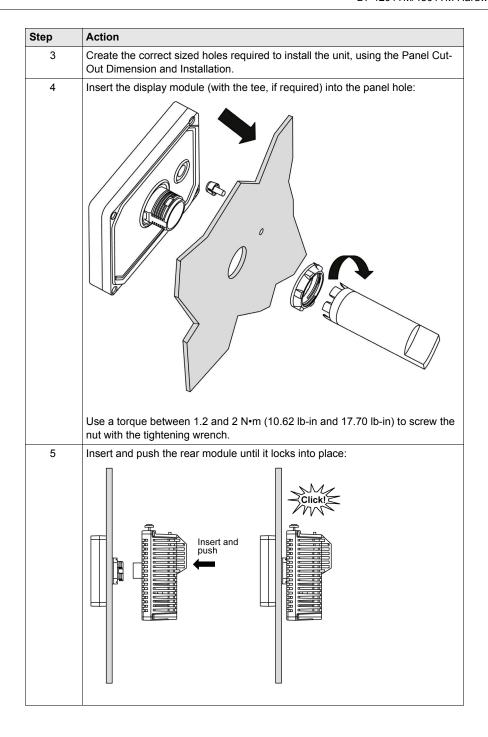

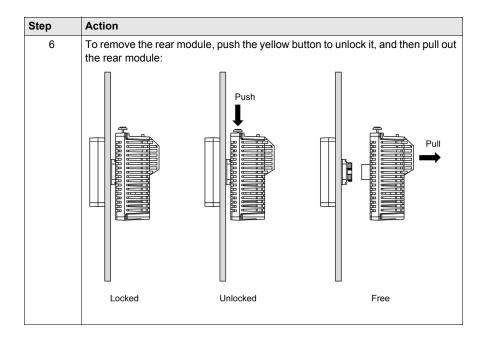

NOTICE

EQUIPMENT DAMAGE

Be sure to remove the rear module from the display module without twisting.


Failure to follow these instructions can result in equipment damage.

Mounting Positions


Correct Mounting Position

The rear module must be mounted with steel sheet horizontally or vertically plane as shown in the figure:



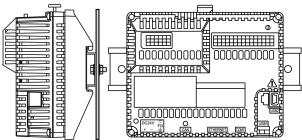

Vertical Mounting




NOTE: Keep adequate spacing for proper ventilation to maintain an ambient temperature between 0...50 °C (32...122 °F) for horizontal installation and 0...40 °C (32...104 °F) for vertical installation.

Incorrect Mounting Position

The rear module should only be positioned as shown in the Correct Mounting Position figure to help ensure adequate air flow through the product.

The figures show incorrect mounting positions:

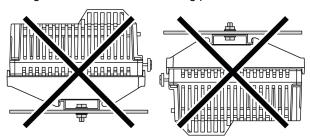

Mounting Clearances

A WARNING

UNINTENDED EQUIPMENT OPERATION

- Place devices dissipating the most heat at the top of the cabinet and ensure adequate ventilation.
- Avoid placing this equipment next to or above devices that might cause overheating.
- Install the equipment in a location providing the minimum clearances from all adjacent structures and equipment as directed in this document.
- Install all equipment in accordance with the specifications in the related documentation.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

NOTE: Keep adequate spacing for proper ventilation to maintain an ambient temperature between 0...50 ° C (32...122 ° F) for horizontal installation and 0...40 ° C (32...104 ° F) for vertical installation.


Mounting and Keeping LT Ventilated

The rear module has been designed as an IP20 product and must be installed in an enclosure.

The clearances must be respected when installing the product:

- Distance and separation between the rear module and the front installation panel.
- Distance and separation between the rear module and wiring ducts.
- Distance and separation between the rear module and peripherals.

The figure shows the minimum clearances for the LT controller:

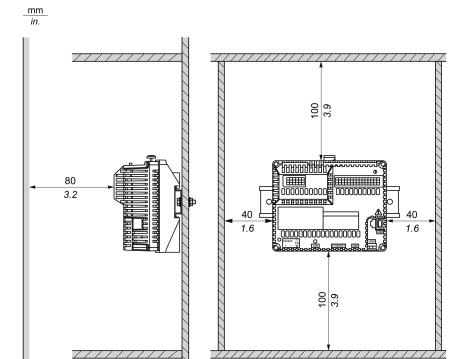



DIN Rail

Dimensions of the DIN Rail

You can mount the controller and its expansion parts on a DIN rail. A DIN rail can be attached to a smooth mounting surface or suspended from a EIA rack or a NEMA cabinet.

The DIN rail measures 35 mm (1.38 in.) high and 15 mm (0.59 in.) deep, as shown below:





Installing and Removing the Rear Module on a DIN Rail

Overview

This section describes how to install and remove the rear module on a DIN rail.

NOTE: The LT should always have the display module and controller module connected for an application to function properly.

If the rear module is powered without it being directly connected (or connected with a separation cable) to the display module, the PLC Logic goes into the STOP mode with I/Os in a fallback mode.

A WARNING

EXPLOSION HAZARD


- Do not connect or disconnect while circuit is live.
- Potential electrostatic charging hazard: wipe the front panel of the terminal with a damp cloth before turning ON.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Installing the Rear Module on a DIN Rail


The following procedure describes how to install the rear module on a DIN rail:

Step	Action					
1	Using screws, to fasten the DIN rail to a panel surfaces.					
2	Affix the display module/rear module separation cable to the rear module.					
	Insert and push					
3	Position the top groove of the rear module on the top edge of the DIN rail and press the assembly against the DIN rail until you hear the DIN rail clip click into place.					

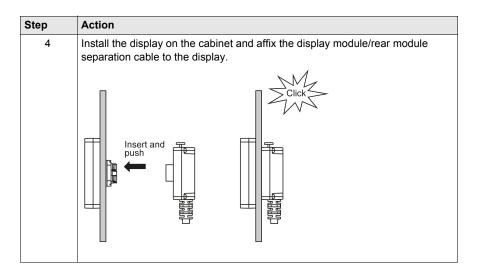

Removing the Rear Module from a DIN Rail

The following procedure describes how to remove the rear module from a DIN rail:

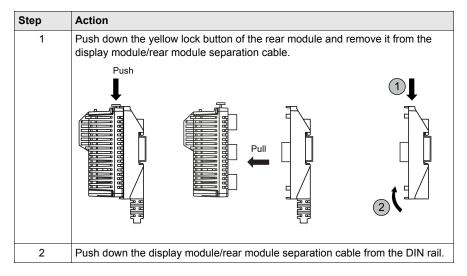

Section 5.2

Electrical Requirements

What Is in This Section?

This section contains the following topics:

Topic	Page
Power Supply Characteristics and Wiring	76
Connecting the Power Cord	78
Connecting the Power Supply	80

Power Supply Characteristics and Wiring

Overview

This section provides the wiring diagrams and the characteristics of the DC power supply.

Power Supply Voltage Range

If the specified voltage range is not maintained, outputs may not switch as expected. Use appropriate safety interlocks and voltage monitoring circuits.

A DANGER

FIRE HAZARD

Use only the recommended wire sizes for I/O channels and power supplies.

Failure to follow these instructions will result in death or serious injury.

A WARNING

UNINTENDED EQUIPMENT OPERATION


Do not exceed any of the rated values specified.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

DC Power Supply Characteristics

Reference		Specification				
Voltage	rated	24 Vdc				
	range	20.428.8 Vdc				
Power interruption	on time	10 ms at 20.4 Vdc				
Maximum inrush	current	30 A at 25 $^{\circ}$ C and at 28.8 Vdc				
Continuous output power	with display	LT-4000M (Modular Type DIO) and PFXXM4200TP (3.5 inch display module): 9 W	LT-4000M (Modular Type Analog) and PFXXM4300TP (5.7 inch display module): 13 W			
	without display	LT-4000M (Modular Type DIO): 7 W	LT-4000M (Modular Type Analog): 10 W			
Insulation Resist	ance	500 Vdc, 10 MΩ or more				
Isolation between DC power supply and internal logic, I/O, and protective ground (PE)		500 Vdc for 1 minute				
Power supply reverse protection		Yes				

DC Power Supply Wiring Diagram



1 Use an external, slow-blow, 2 A type T fuse.

A DANGER

FIRE HAZARD

Use only the recommended wire sizes for I/O channels and power supplies.

Failure to follow these instructions will result in death or serious injury.

A WARNING

UNINTENDED EQUIPMENT OPERATION

Do not exceed any of the rated values specified.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Power Interruption

The Voltage Drop is variable depending upon the load to the power supply of the controller, but generally a minimum of 10 ms is maintained as specified by IEC standards.

LT enters power-down status when a momentary power interruption of the rated voltage continues for 10 ms or longer. When the LT enters power-down status, it stops all calculations, even if there are instructions that are not completed.

For example, when the LT enters power-down status while 100 words of data are being transferred by a FMOV instruction, the transfer stops midway. Consequently, design your program with consideration to power-down occurrences.

A WARNING

UNINTENDED EQUIPMENT OPERATION

- Individually monitor each source of power used in the LT system including input power supplies, output power supplies, and the power supply to the controller to allow appropriate system shutdown during power system interruptions.
- The inputs monitoring each of the power supply sources must be unfiltered inputs.

Connecting the Power Cord

Introduction

Follow these instructions when supplying power to the unit:

- When the frame ground (FG) terminal is connected, verify the wire is grounded. Not grounding
 the unit can result in excessive Electromagnetic Interference (EMI). Grounding is required to
 meet EMC level immunity.
- The shield ground (SG) and FG terminals are connected internally in the unit.
- Remove power before wiring to the power terminals of the unit.
- The unit uses 24 Vdc power. Using any other level of power can damage both the power supply and the unit.
- Since the unit is not equipped with a power switch, connect a power switch to the unit's power supply.
- Field wiring terminal marking for wire type (75° C (167F) copper conductors only).

Power Cord Preparation

Before using your power cord:

- Verify that the ground wire is the same gauge or heavier than the power wires.
- Do not use aluminum wires for the power cord for power supply.
- If the conductor end (individual) wires are not twisted correctly, the end wires may either short loop to each other or against an electrode. To avoid this, use D25CE/AZ5CE cable ends.
- Use wires that are 0.75 to 2.5 mm² (18 to 12 AWG) for the power cord, and twist the wire ends before attaching the terminals.
- The conductor type is solid or stranded wire.
- To reduce electromagnetic noise, make the power cord as short as possible.

Power Plug



Connection	Wire
+	24 Vdc
-	0 Vdc
FG	Grounded terminal connected to the unit chassis

Connecting the Power Cord

The table explains how to connect the power plug:

Step	Action
1	Confirm the power cord is not connected to the power supply.
2	Check the rated voltage and remove the "DC24V" sticker on the DC power supply connector.
3	Remove 10 mm (0.39 in.) of the vinyl membrane off the ends of the power code wires.
4	If using stranded wire, twist the ends. Tinning the ends with solder reduces risk of fraying and ensures good electrical transfer.

Step	Action
5	Push the Opening button with a small and flat screwdriver to open the desired pin hole.
6	Insert each pin terminal into its corresponding hole. Release the Opening button to clamp the pin in place. Opening Button O
7	After inserting all three pins, insert the power plug into the power connector on the LT.

NOTE:

- Do not solder the wire directly to the power receptacle pin.
- The power supply cord must meet the specification shown above. Twist the power cords together, up to the power plug, for EMC compliance.
- Use field wiring terminal marking for wire type (75 °C (167 °F) copper conductors only).

Connecting the Power Supply

Precautions

- Use the power plug to connect the power cord to the power connector on the side of the rear module.
- Use a regulated power supply with a Class 2 power supply between the line and the ground.
- Do not bundle the power supply cord with, or keep close to, main circuit lines (high voltage, high current), or I/O signal lines.
- Connect a lightning surge absorber to handle power surges.

Excessive stress on the power connection or attempting to install a rear module with the power cables connected may disconnect, or cause damage, to the power connections. This can cause short circuits, fire, or unintended equipment operation.

A WARNING

SHORT CIRCUITS, FIRE, OR UNINTENDED EQUIPMENT OPERATION


Avoid excessive force on the power cable to prevent accidental disconnections:

- Securely attach power cables to the panel or cabinet.
- Secure the power plug of the rear module.
- Install and fasten the rear module on the installation panel or cabinet prior to connecting power supply and communication lines.


Failure to follow these instructions can result in death, serious injury, or equipment damage.

Power Supply Connections

For maintenance purpose, use the following connection diagram to set up your power supply connections. However, when terminals A2 and B2 (signal name: Q1, Q0) are wired to external I/O, use the same power source for external I/O and the LT.




When wiring terminals A2 and B2 (signal name: Q1, Q0) to external I/O.




NOTE:

When connector A2 and B2 (Signal Name: Q1, Q0) are wired to external I/O, turn on the LT before turning on the external device. Otherwise the wrong signal for Pulse Output, PWM Output and High-speed Counter (Synchronize Output) will be output. When transferring a program that turns off or resets the LT, first turn off the external device. When using a system with multiple power supplies, please note there is also a power supply in the external device.

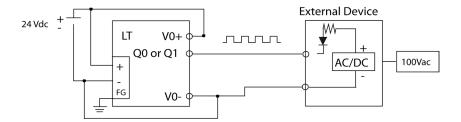

- Ground the surge absorber separately from the rear module.
- Select a surge absorber that has a maximum circuit voltage greater than the peak voltage of the power supply.

The diagram illustrates a lightning surge absorber connection:



Section 5.3 USB Port

Overview

This section presents the USB port.

What Is in This Section?

This section contains the following topics:

Topic	Page
USB Data Transfer Cable - USB Driver Installation	83
USB (Type A)	84
USB (mini-B)	86

USB Data Transfer Cable - USB Driver Installation

Important Information

Follow these instructions to avoid damage to the cable connector or the unit:

- Do not connect the USB data transfer cable until told to do so in the instructions.
- Insert the connector at the correct angle when connecting the USB data transfer cable to the PC or to the unit.
- Hold the connector, not the cable itself when disconnecting the cable.
- Use the port designated during installation. If the cable is unplugged from the port designated during installation and connected to a different port, the Operating System (OS) does not recognize the new port.
- Restart the PC and quit all resident applications before reinstalling the software if the installation
 does not complete successfully.

NOTE: For transfer methods, refer to the following manual: GP-Pro EX Reference Manual "Transferring project files via USB transfer cable".

USB Host Interface Characteristics

	USB (Type A) Interface	USB (mini-B) Interface
Connector	USB 2.0 (Type A) x 1	USB 2.0 (mini-B) x 1
Power Supply Voltage	5 Vdc ± 5%	_
Maximum Current Supplied	500 mA	_
Maximum Transmission Distance	5 m (16.4 ft)	

USB (Type A)

Introduction

A WARNING

RISK OF EXPLOSION IN HAZARDOUS LOCATIONS


In hazardous locations as described in ANSI/ISA - 12.12.01:


- Confirm that the USB cable has been attached with the USB cable clamp before using the USB host interface.
- Remove power before attaching or detaching any connector(s) to or from the unit.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

When using a USB device, you can attach a USB holder to the USB interface on the side of the unit to help prevent the USB cable from being disconnected.


Attaching the USB Holder

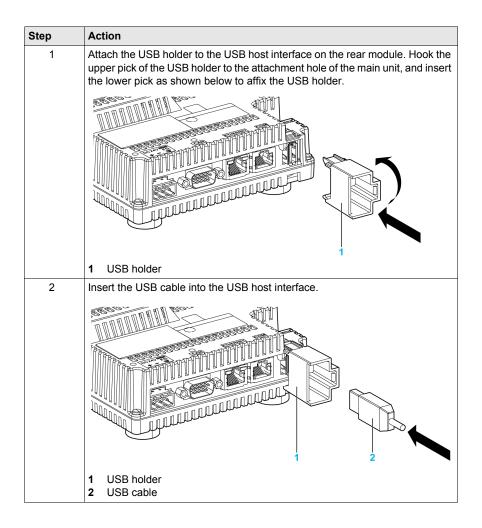

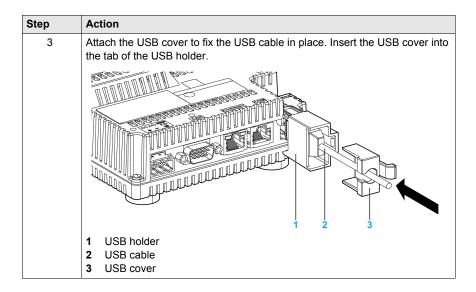

Removing the USB Holder

Push the tab of the USB holder to the left and then remove the USB cover.

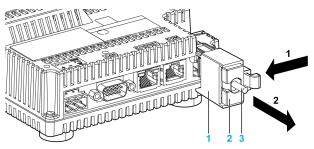

- 1 USB holder
- 2 USB cover
- 3 USB cable

USB (mini-B)

Introduction

A WARNING

RISK OF EXPLOSION IN HAZARDOUS LOCATIONS

In hazardous locations as described in ANSI/ISA - 12.12.01:


- Confirm that the USB cable has been attached with the USB cable clamp before using the USB host interface.
- Remove power before attaching or detaching any connector(s) to or from the unit.


Failure to follow these instructions can result in death, serious injury, or equipment damage.

When using a USB device, you can attach a USB holder to the USB interface on the unit to help prevent the USB cable from being disconnected.

NOTE: The USB holder is supplied in the accessory kit PFXZGMAK1 (sold separately).


Attaching the USB Holder

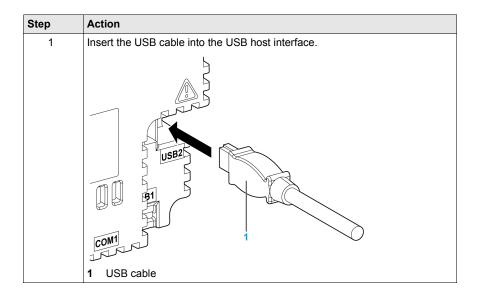

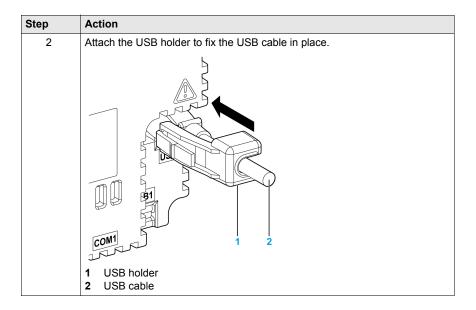

Removing the USB Holder

Push down the tab of the USB holder and then remove the USB holder.



- 1 USB holder
- 2 USB cable

Part II

LT Unit and Display Modules

Overview

This part describes the LT Unit and the display modules.

What Is in This Part?

This part contains the following chapters:

Chapter	Chapter Name		
6	LT-4201TM/4301TM (Modular Type DIO)	91	
7	LT-4201TM/4301TM (Modular Type Analog)	99	
8	Display Modules	111	

Chapter 6

LT-4201TM/4301TM (Modular Type DIO)

Overview

This chapter describes the LT-4201TM/4301TM (Modular Type DIO).

What Is in This Chapter?


This chapter contains the following topics:

Topic	Page
Presentation	92
Digital Inputs	94
Digital Outputs	96


Presentation

Terminal Blocks

The figure shows the terminal blocks:

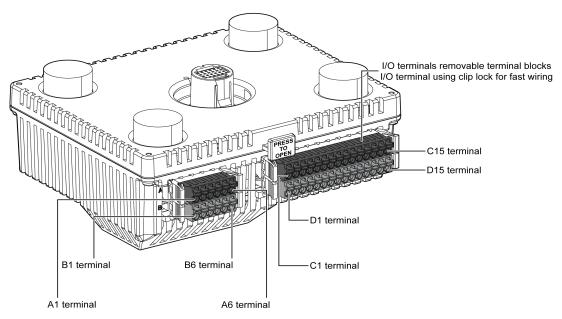

The figure shows the pin assignment of the terminal blocks:

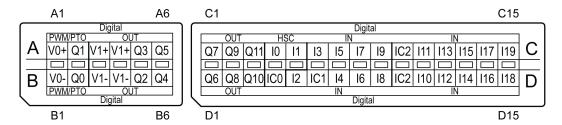

NOTE: Confirm the connector label ABCD and the stamp ABCD on the unit before wiring.

The table shows the group and signal names of the terminal blocks:

Pin Arrangement	Group	Pin	Signal Name	Group	Pin	Signal Name
	Fast Output	A1	V0+	Fast Output	B1	V0-
B1 OND A1		A2	Q1		B2	Q0
	Standard	A3	V1+	Standard Output	B3	V1-
	Output	A4	V1+		B4	V1-
		A5	Q3		B5	Q2
B6 OID OID A6		A6	Q5		B6	Q4

The table shows the group and signal names of the terminal blocks:

Pin Arrangement	Group	Pin	Signal Name	Group	Pin	Signal Name
	Standard Output	C1	Q7	Standard Output	D1	Q6
D1 0110 C1		C2	Q9		D2	Q8
		C3	Q11		D3	Q10
	Fast Input/Standard Input	C4	10	Fast Input/Standard Input	D4	IC0
		C5	l1	Standard Input	D5	12
	Standard Input	C6	13		D6	IC1
		C7	15		D7	14
		C8	17		D8	16
		C9	19		D9	18
D15 OID OID C15		C10	IC2		D10	IC2
		C11	l11		D11	I10
		C12	I13		D12	l12
		C13	I15		D13	l14
		C14	117		D14	I16
		C15	l19		D15	I18

A A DANGER

HAZARD OF ELECTRIC SHOCK, EXPLOSION OR ARC FLASH

- Disconnect all power from all equipment including connected devices prior to removing any
 covers or doors, or installing or removing any accessories, hardware, cables, or wires except
 under the specific conditions specified in the appropriate hardware guide for this equipment.
- Always use a properly rated voltage sensing device to confirm the power is off where and when
 indicated.
- Replace and secure all covers, accessories, hardware, cables, and wires and confirm that a proper ground connection exists before applying power to the unit.
- Use only the specified voltage when operating this equipment and any associated products.

Failure to follow these instructions will result in death or serious injury.

Digital Inputs

Overview

The rear module is equipped with 20 digital inputs.

A DANGER

FIRE HAZARD

Use only the recommended wire sizes for I/O channels and power supplies.

Failure to follow these instructions will result in death or serious injury.

Input Management Functions Availability

The table describes the possible usage of the rear module inputs:

Function		Input Function			
		Standard Input	Fast Input	Counter Input	
Filtering Time		0.5 ms30 ms	None/4 μs/40 μs		
Fast	10	X	X	Χ	
Input ¹	I1	Χ	X	Χ	
Digital	12	X	-	-	
Input	13	Χ	_	-	
	14	X	-	-	
	15	X	-	-	
	16	Χ	_	-	
	17	X	-	-	
	18	X	-	-	
	19	Χ	_	-	
	I10	Х	-	-	
	I11	X	-	-	
	I12	X	_	-	
	I13	Х	-	-	
	l14	X	-	_	
	115	Х	_	_	
	I16	X	-	-	
	117	X	-	-	
	I18	X	-	-	
	l19	Х			

X Yes


NOTE: You can use filters and functions to manage the LT's inputs.

No

¹ Can also be used as a regular input

Wiring Diagram

The figure describes the wiring diagram of the LTs digital inputs. Refer to Terminal Blocks. Fast Input/Standard Input:

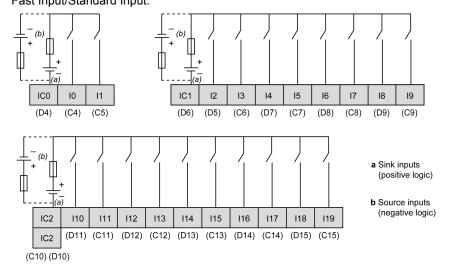

A WARNING

UNINTENDED EQUIPMENT OPERATION

Do not connect wires to unused terminals or terminals marked "Not Connected (N.C.)".

Failure to follow these instructions can result in death, serious injury, or equipment damage.

A WARNING

UNINTENDED EQUIPMENT OPERATION

Use a single power source for the sensor and actuator.

Digital Outputs

Overview

The rear module is equipped with 12 digital outputs that you can manage.

A DANGER

FIRE HAZARD

Use only the recommended wire sizes for I/O channels and power supplies.

Failure to follow these instructions will result in death or serious injury.

Output Management Functions Availability

The table describes the possible usage of the rear module outputs:

Function		Output Function		
		Standard Output	Pulse Output/PWM Output	
Fast	Q0	-	Х	
Output ¹	Q1	_	Х	
Digital	Q2	X	_	
Output	Q3	X	_	
	Q4	X	_	
	Q5	X	-	
	Q6	X	-	
	Q7	X	-	
	Q8	X	_	
	Q9	X	-	
	Q10	X	-	
	Q11	X	-	
V Voc	1	1		

X Yes

Fast Output Wiring Diagram

For additional information about fast output protection, refer to Protecting Outputs from Inductive Load Damage (see page 34).

A WARNING

UNINTENDED EQUIPMENT OPERATION

Be sure to wire the outputs correctly according to the wiring diagram.

No


Can also be used as a regular output

Wiring Diagram

The figure describes the wiring diagram of the LTs digital outputs. Refer to Terminal Blocks.


NOTE: When terminals A2 and B2 (signal name: Q1, Q0) are wired to external I/O, use the same power source for external I/O and the LT. Refer to Power Supply Connections.

Standard output:

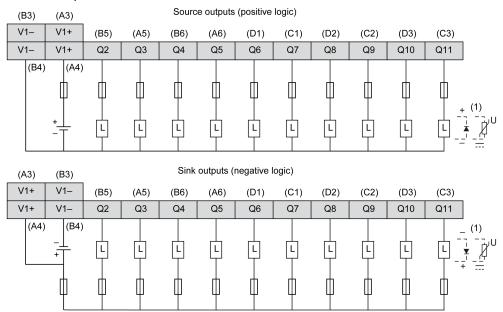

(1) When connecting as power surges

Pulse Output/PWM Output/High-speed Counter (Synchronize Output):

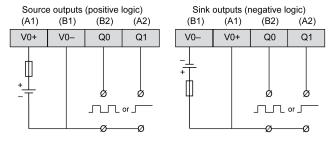


NOTE:

Q0 and Q1 circuits are push-pull circuits. The following is the operation of the push-pull circuit at the Sink Output and the Source Output:

- Sink Output: +24(V) is output to terminal Q0, Q1 when the logic for Q0, Q1 is off.
- Source Output: 0(V) is output to terminal Q0, Q1 when the logic for Q0, Q1 is off.

Standard Output terminals Q2 or later are common open collector outputs. Do not connect Fast Output terminals Q0, Q1 and Standard Output terminals Q2 or later. It will short. If you add a manual circuit to terminal Q0, Q1, isolate the manual circuit and terminal Q0, Q1 with a relay. Without isolation, it will short.

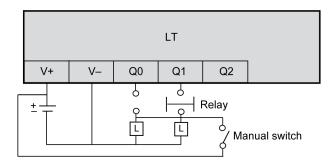

A WARNING

UNINTENDED EQUIPMENT OPERATION

Do not connect wires to unused terminals or terminals marked "Not Connected (N.C.)".

Chapter 7

LT-4201TM/4301TM (Modular Type Analog)

Overview

This chapter describes the LT-4201TM/4301TM (Modular Type Analog).

What Is in This Chapter?


This chapter contains the following topics:

Topic	Page
Presentation	100
Digital Inputs	102
Digital Outputs	104
Analog Inputs and Analog Outputs	107


Presentation

Terminal Blocks

The figure shows the terminal blocks:

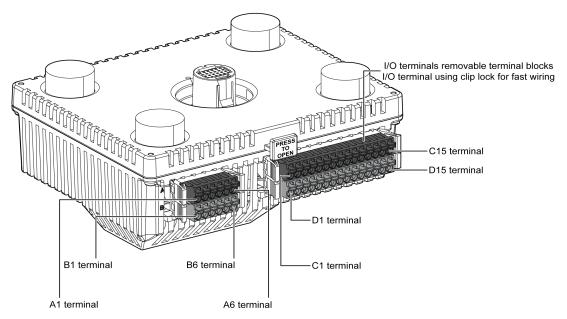

The figure shows the pin assignment of the terminal blocks:

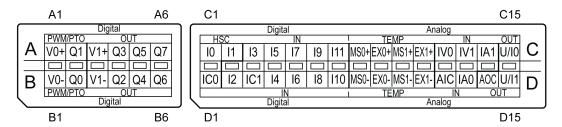

NOTE: Confirm the connector label ABCD and the stamp ABCD on the unit before wiring.

The table shows the group and signal names of the terminal blocks:

Pin Arrangement	Group	Pin	Signal Name	Group	Pin	Signal Name
B1 OII OII A1 OII OII A1 OII OII OII A6	Fast Output	A1	V0+	Fast Output	B1	V0-
		A2	Q1		B2	Q0
	Standard Output	A3	V1+	Standard Output	B3	V1-
		A4	Q3		B4	Q2
		A5	Q5		B5	Q4
		A6	Q7		B6	Q6

AIC

IA0

AOC

U/I1

D12

D13

D14

D15

Pin Arrangement Group Pin Signal Group Pin Signal Name Name C1 10 Fast Fast D1 IC0 Input/Standard Input/Standard D1 C1 Input Input C2 11 Standard Input D2 12 13 Standard Input C3 D3 IC1 C4 15 D4 14 C5 17 D5 16 C6 19 D6 18 C7 111 D7 I10 Temperature C8 MS0+ D8 Temperature MS0-Input Input C9 EX0+ D9 EX0-MS1-C10 MS1+ D10 D15 OID OID C11 FX1+ D11 FX1-

The figure shows the group and the signal name of the terminal blocks:

A A DANGER

IV0

IV1

IA1

U/I0

Analog Input

Analog Output

C12

C13

C14

C15

HAZARD OF ELECTRIC SHOCK, EXPLOSION OR ARC FLASH

Analog Input

Analog Output

- Disconnect all power from all equipment including connected devices prior to removing any
 covers or doors, or installing or removing any accessories, hardware, cables, or wires except
 under the specific conditions specified in the appropriate hardware guide for this equipment.
- Always use a properly rated voltage sensing device to confirm the power is off where and when
 indicated.
- Replace and secure all covers, accessories, hardware, cables, and wires and confirm that a proper ground connection exists before applying power to the unit.
- Use only the specified voltage when operating this equipment and any associated products.

Failure to follow these instructions will result in death or serious injury.

Digital Inputs

Overview

The rear module is equipped with 12 digital inputs.

A DANGER

FIRE HAZARD

Use only the recommended wire sizes for I/O channels and power supplies.

Failure to follow these instructions will result in death or serious injury.

Input Management Functions Availability

The table describes the possible usage of the rear module inputs:

Function		Input Function			
		Standard Input	Fast Input	Counter Input	
Filtering Time		0.530.0 ms	None/4 μs/40 μs		
Fast	10	Х	X	X	
Input ¹	I1	X	X	X	
Digital	12	X	_	_	
Input	13	X	-	_	
	14	Х	-	-	
	15	X	-	-	
	16	X	_	_	
	17	X	-	-	
	18	X	-	-	
	19	X	_	_	
	I10	X	_	_	
	l11	Х	_	_	

X Yes


NOTE: You can use filters and functions to manage the LT' inputs.


No

Can also be used as a regular input

Wiring Diagram

The figure describes the wiring diagram of the LTs digital inputs. Refer to Terminal Blocks. High-speed Input/Standard Input:





- a Sink inputs (positive logic)
- **b** Source inputs (negative logic)

A WARNING

UNINTENDED EQUIPMENT OPERATION

Do not connect wires to unused terminals or terminals marked "Not Connected (N.C.)".

Failure to follow these instructions can result in death, serious injury, or equipment damage.

A WARNING

UNINTENDED EQUIPMENT OPERATION

Use a single power source for the sensor and actuator.

Digital Outputs

Overview

The rear module is equipped with 8 digital outputs that you can manage.

A DANGER

FIRE HAZARD

Use only the recommended wire sizes for I/O channels and power supplies.

Failure to follow these instructions will result in death or serious injury.

Output Management Functions Availability

The table describes the possible usage of the rear module outputs:

Function		Output Function		
		Standard Output	Pulse Output/PWM Output	
Fast	Q0	_	X	
Output ¹	Q1	_	Х	
Digital	Q2	X	_	
Output	Q3	X	_	
	Q4	Х	_	
	Q5	X	_	
	Q6	Х	-	
	Q7	Х	-	

X Yes

Fast Output Wiring Diagram

For additional information about fast output protection, refer to Protecting Outputs from Inductive Load Damage (see page 34).

A WARNING

UNINTENDED EQUIPMENT OPERATION

Be sure to wire the outputs correctly according to the wiring diagram.

⁻ No

Cannot be used as a regular output


Wiring Diagram

The figure describes the wiring diagram of the LTs digital outputs. Refer to Terminal Blocks.


NOTE: When terminals A2 and B2 (signal name: Q1, Q0) are wired to external I/O, use the same power source for external I/O and the LT. Refer to Power Supply Connections.

Standard output:

Source outputs (positive logic)

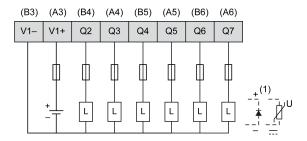


Sink outputs (negative logic)



(1) When connecting as power surges

Pulse Output/PWM Output/High-speed Counter (Synchronize Output):

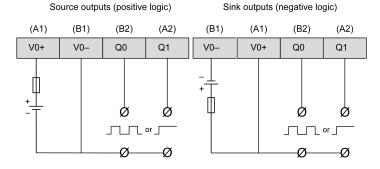


NOTE:

Q0 and Q1 circuits are push-pull circuits. The following is the operation of the push-pull circuit at the Sink Output and the Source Output:

- Sink Output: +24(V) is output to terminal Q0, Q1 when the logic for Q0, Q1 is off.
- Source Output: 0(V) is output to terminal Q0, Q1 when the logic for Q0, Q1 is off.

Standard Output terminals Q2 or later are common open collector outputs. Do not connect Fast Output terminals Q0, Q1 and Standard Output terminals Q2 or later. It will short. If you add a manual circuit to terminal Q0, Q1, isolate the manual circuit and terminal Q0, Q1 with a relay. Without isolation, it will short.

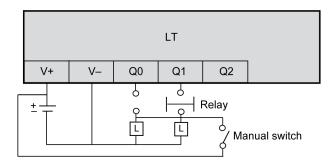

A WARNING

UNINTENDED EQUIPMENT OPERATION

Do not connect wires to unused terminals or terminals marked "Not Connected (N.C.)".

Analog Inputs and Analog Outputs

Overview

The rear module is equipped with:

- 2 ch Thermocouple/Temperature Probes (16-bit)
- 2 ch analog inputs (13-bit)
- 2 ch analog outputs (12-bit)

A DANGER

FIRE HAZARD

Use only the recommended wire sizes for I/O channels and power supplies.

Failure to follow these instructions will result in death or serious injury.

A WARNING

UNINTENDED EQUIPMENT OPERATION

Do not exceed any of the rated values specified.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Analog Features

There are different terminal connection points for each type of analog signal.

Since current and voltage requires different adjustment values, you also need to configure the desired type of input or output signal:

- -10...10 Vdc voltage signal (default).
- 0...10 Vdc voltage signal
- 0...20 mA current signal.
- 4...20 mA current signal.


The temperature measurement values are converted into numeric values that can be processed by the controller. For temperature measurements, the temperature rear module returns the measured value in 0.1°C (0.18°F) steps.

The table shows the analog features:

Number and Type of Channels	Digital Resolution	Voltage/Current
2 ch inputs	13 bit	-1010 Vdc (digital value -4096 to 4095) 010 Vdc (digital value 0 to 8192) 020 mA (digital value 0 to 8192) 420 mA (digital value 0 to 8192)
2 ch inputs	16 bit	RTD (Resistance Temperature Detector): PT100/PT1000/NI100/NI1000 Thermocouple: J, K, R, B, S, T, E, N
2 ch outputs	12 bit	-1010 Vdc (digital value -2048 to 2047) 010 Vdc (digital value 0 to 4095) 020 mA (digital value 0 to 4095) 420 mA (digital value 0 to 4095)

Wiring Diagram

The figure describes the wiring diagram of the rear module analog inputs and analog outputs:

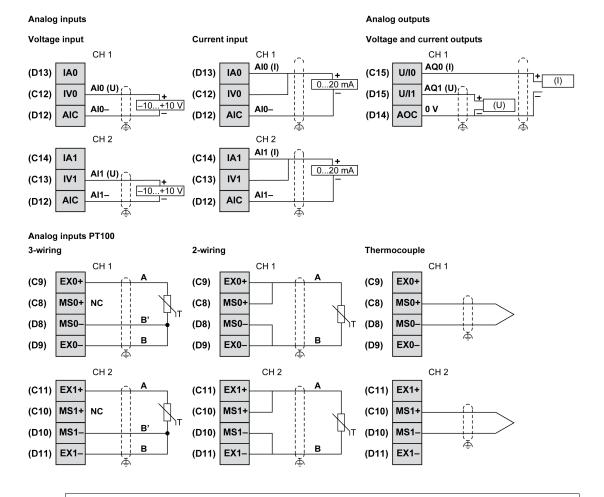

A WARNING

UNINTENDED EQUIPMENT OPERATION

Do not connect wires to unused terminals or terminals marked "Not Connected (N.C.)".

Failure to follow these instructions can result in death, serious injury, or equipment damage.

A WARNING

IMPROPER GROUNDING CAN CAUSE UNINTENDED EQUIPMENT OPERATION

- Use cables with insulated shielded jackets for analog I/O, fast I/O and communication signals.
- Ground shielded cables for analog I/O, fast I/O and communication signals at a single point ¹.
- Always comply with local wiring requirements regarding grounding of cable shields.

¹Multipoint grounding is permissible if connections are made to an equipotential ground plane dimensioned to help avoid shielded cable damage in the event of power system short circuit currents.

A WARNING

UNINTENDED EQUIPMENT OPERATION

- Use shielded cables wherever specified for inputs, outputs, and communication connections.
- Properly ground the cable shields as indicated in the related documentation.
- Route communication and I/O cables separately from power cables.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

NOTICE

INOPERABLE EQUIPMENT

Be sure that the physical wiring of the analog circuit is compatible with the software configuration for the analog channel.

Failure to follow these instructions can result in equipment damage.

Chapter 8Display Modules

Panel Overview

Introduction

The LT is a Human Machine Interface product that has an operating voltage of 24 Vdc.

The table describes the LT characteristics:

Part Number	Screen Size	Screen (Pixel) Resolution	Color Definition	Screen Type
LT-4201TM (Modular Type DIO)	3.5 in.	320 x 240 (QVGA)	65536 colors and LED backlight	TFT
LT-4201TM (Modular Type Analog)				
3.5 inch display module				
LT-4301TM (Modular Type DIO)	5.7 in.			
LT-4301TM (Modular Type Analog)				
5.7 inch display module				

Critical Systems, Detected Alarms and Handling Requirements

Critical detected alarm indicators and system functions require independent and redundant protection hardware and/or mechanical interlocks.

If the unit for any reason becomes inoperative (for example, an inoperative backlight) it may be difficult or impossible to identify operation. Operations that may present a hazard if not immediately executed, such as emergency stop, must be provided independently of the unit. The design of the control system must take into account an inoperative unit (backlight) and the operator may be unable to control the machine or respond to detected errors with the unit.

After turning OFF the LT, be sure to wait at least 10 seconds before turning it ON again. The LT may not operate correctly if it is restarted too guickly.

A WARNING

LOSS OF CONTROL

- Consider the potential failure modes of control paths in the machine control system design, such as:
 - The possibility of backlight failure,
 - Unanticipated link transmission delays or failures,
 - The operator being unable to control the machine.
 - The operator making errors in the control of the machine.
- Design outside the LT operations such as emergency stop, safety circuits, interlocks that operate with opposing actions such as clockwise/counterclockwise rotation, and circuits that prevent machine damage with positioning limits on top, bottom, and movement.
- For important operations handled by switches, design your system to use a separate hardware device. This is to reduce the occurrence of incorrect outputs or malfunctions.
- Observe all accident prevention regulations and local safety guidelines.¹
- Test individually and thoroughly each implementation of the equipment for correct operation before service.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

¹ For additional information, refer to NEMA ICS 1.1 (latest edition), "Safety Guidelines for the Application, Installation, and Maintenance of Solid State Control" and to NEMA ICS 7.1 (latest edition), "Safety Standards for Construction and Guide for Selection, Installation and Operation of Adjustable-Speed Drive Systems" or their equivalent governing your particular location.

A WARNING

UNINTENDED EQUIPMENT OPERATION

- Do not use the LT as a control unit for system critical operations such as start/stop or output control of motors.
- Do not use the LT as the only warning device for critical alarms such as device overheat or device over-current.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Handling the LCD

The following characteristics are specific to the LCD and are considered normal behavior:

- LCD screen may show unevenness in the brightness of certain images or may appear different
 when seen from outside the specified viewing angle. Extended shadows, or cross-talk, may also
 appear on the sides of screen images.
- LCD screen pixels may contain black and white-colored spots and color display may seem to have changed over time.
- When the same image is displayed on the screen for a long period, an after-image may appear
 when the image is changed. If this happens, turn off the unit, wait 10 seconds, and then restart it.

NOTE: Do not display the same image for a long time. Change the screen image periodically.

A CAUTION

SERIOUS EYE AND SKIN INJURY

The liquid present in the LCD contains an irritant:

- Avoid direct skin contact with the liquid.
- Wear gloves when you handle a broken or leaking unit.
- Do not use sharp objects or tools in the vicinity of the LCD touch panel.
- Handle the Panel carefully to prevent puncture, bursting, or cracking of the Panel material.

Failure to follow these instructions can result in injury or equipment damage.

If the Panel is damaged and any liquid comes in contact with your skin, immediately rinse the area with running water for at least 15 min.

If the liquid gets in your eyes, immediately rinse your eyes with running water for at least 15 minutes and consult a doctor.

Using Touch Panel Correctly

A WARNING

UNINTENDED EQUIPMENT OPERATION

- Operate the touch panel with only one finger.
- Do not activate two or more points of the touch panel simultaneously.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Use only one finger to select an object on the touch panel.

If the touch panel receives pressure at two or more points at the same time, an unintended object could be selected.

Part III

LT Controller Panels

Overview

This part describes how to use LT controller panels.

What Is in This Part?

This part contains the following chapters:

Chapter	Chapter Name	
9	Communication Interface	117
10	Specifications	
11	Maintenance	143

Chapter 9

Communication Interface

What Is in This Chapter?

This chapter contains the following topics:

Торіс	Page
Ethernet Port	118
CANopen Master Unit	120
Serial Interface (COM1)	124


Ethernet Port

Introduction

The LT is equipped with an IEEE802.3 compliant Ethernet communication port that transmits and receives data at 10 Mbps or 100 Mbps.

Ethernet Port Connector

The figure shows the location of the RJ45 Ethernet port on the rear module:



Do not confuse the RJ45 Ethernet connector with the RJ45 serial interface.

NOTE: When you use a 1:1 connection to connect to a device such as PC, you can use a cross cable, but we recommend using a hub.

Characteristics

The table describes the different Ethernet characteristics:

Characteristic	Description
Connector type	RJ45
Driver	10 M half duplex (auto negotiation)100 M full duplex (auto negotiation)
Cable type	Shielded
Automatic cross-over detection	Yes

Pin Assignment

The figure shows the RJ45 Ethernet connector pin assignment:



The table describes the RJ45 Ethernet connector pins:

Pin	Signal
1	TD+
2	TD-
3	RD+
4	_
5	_
6	RD-
7	_
8	_

NOTE: The LT supports the MDI/MDIX auto-crossover cable function. You do not have to use special Ethernet crossover cables to connect devices directly to this port (connections without an Ethernet hub or switch).

Status LEDs

The table describes the Ethernet status LEDs operations:

Label	Description	LED		
		Color	Status	Description
IND1	Ethernet status	us Green Off	Off	No connection or subsequent transmission failure.
			On	Data transmission is available.
IND2	Ethernet activity	Green	Off	No data transmission.
			On	Data transmission is occurring.

CANopen Master Unit

CANopen Capabilities

The table describes the LT CANopen master features:

Maximum number of slaves on the bus	16 CANopen slave devices
Maximum length of CANopen fieldbus cables	According to the CAN specification (see Cable Length and Transmission Speed).
Maximum number of PDOs managed by the master	32 TPDOs + 32 RPDOs

For each additional CANopen slave:

- The application size increases by an average of 10 kbytes, which can result in a memory size overload.
- The configuration initialization time at the startup increases, which can lead to a watchdog condition.

Although LT does not restrict you from doing so, we recommend that you not exceed 16 CANopen slave modules (and/or 32 TPDOs and 32 RPDOs) for sufficient performance tolerance and to avoid performance degradation.

A WARNING

UNINTENDED EQUIPMENT OPERATION

Do not connect more than 16 CANopen slave devices to the LT.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

NOTICE

DEGRADATION OF PERFORMANCE

Do not exceed 32 TPDOs and 32 RPDOs for the LT Unit.

Failure to follow these instructions can result in equipment damage.

Characteristics

The table describes the CAN characteristics:

Characteristic	Description
Standard	CAN-CiA (ISO 11898-2:2002 Part 2) ¹
Connector type	Sub-D9, 9 pins male
Protocol supported	CANopen
CAN power distribution	No
Maximal cable length	See table below ⁴
Isolation	See note ²
Bit rate	See table below ⁴
Line termination	No. See note ³


¹ Part 1 and Part 2 of ISO 11898:2002 are equivalent to ISO 11898:1993.

⁴ The table describes the maximum cable lengths:

Baud rate		800 Kbit/s	250 Kbit/s	125 Kbit/s	50 Kbit/s	20 Kbit/s	10 Kbit/s
Maximum	m	25	250	500	1000	2500	5000
cable length	ft.	82.02	820.20	1640.41	3280.83	8202.07	16404.15

Pin Assignment

The graphic describes the pins of the CANopen interface:



² The isolation of the rear module is 500 Vac RMS between the module and the terminal blocks connected to the rear module. The two parts reference the same functional ground (FE) through specific components designed to reduce effects of electromagnetic interference. These components are rated at 30 Vdc or 60 Vdc. This effectively reduces isolation of the entire system from the 500 Vac RMS.

³ A resistor (R) is needed on each end of the CAN field bus.

The table describes the pins of the CANopen interface:

PIN	Signal	Description
1	N.C.	Reserved
2	CAN_L	CAN_L bus Line (Low)
3	CAN_GND	CAN 0 Vdc
4	N.C.	Reserved
5	CAN_SHLD	N.C.
6	GND	0 Vdc
7	CAN_H	CAN_H bus Line (High)
8	N.C.	Reserved
9	N.C.	Reserved

The shield is connected to pin 6, the 0 Vdc pin.

NOTE: Pin 9 is not connected internally. The controller does not provide power on CAN_V+.

A WARNING

UNINTENDED EQUIPMENT OPERATION

Do not connect wires to unused terminals or terminals marked "Not Connected (N.C.)".

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Status LED

The table describes the CAN status LED:

Marking	Description	LED	
		Color	Description
CAN STS	CANopen status	Green / Red	See CAN STS status LED below

The table describes the CAN STS status LED:

CAN0 LED	CANopen Status	Description
OFF	No CANopen configured	CANopen is not active in the application.
Single flash red / with green ON	Acceptable detected error limit threshold has been reached	The controller has detected that the maximum number of error frames has been reached or exceeded.
Double flash red / with green ON	Node Guarding or Heartbeat event	The controller has detected either a Node Guarding or Heartbeat exception for the CANopen master or slave device.
Red ON	Bus off	The CANopen bus is stopped.
Green ON	The CANopen bus is operational.	

NOTE: CanOpen LED is mounted alongside the cover.

CANopen DATA TRANSFER SETTINGS

The CANopen networking concept is based on the international standard CAN. CANopen is defined as a uniform application layer by the DS301 specifications of the CiA (CAN in Automation).

CANopen CABLE ARRANGEMENT

The CANopen interface uses a D-SUB 9-pin plug connector. The plug is assigned with the CAN_H, CAN_L and, CAN_GND connections. CAN_H and CAN_L are the two conductors of the CAN bus. CAN_GND is the common reference potential.

NOTE:

- The resistance of the cable value must be 70 mW/m (1.77 mW / in.) or less.
- To minimize signal reflections from the end of the cable, a 120 W. (5%, 1/4 W maximum) line termination must be placed at both ends of the bus.

CANopen Communication Cable and Connectors

NOTE: CANopen communication cables and cable connectors are not supplied with the CANopen Master Unit. The user must prepare the cables.

Recommended Cable Connector

D-SUB (DIN41652) connector compliant with CANopen Standard (CiA DR-303-1)

CANopen Recommended Transfer Cable

Transfer cable (a twisted pair cable with a shield) compliant with CANopen Standard (CiA DR-303-1)

Serial Interface (COM1)


Introduction

The serial interface is used to communicate with devices supporting the Modbus protocol as a master.

To enable communications through serial links, the LT includes an RS-232/485 serial link.

Serial Port Connector

The figure shows the location of the RJ45 serial port on the rear module:



Do not confuse the RJ45 serial port with the RJ45 Ethernet interface.

RS-232C Characteristics

Characteristic		Description
Connector type		RJ45
Isolation		None
Maximum baud rate		115,200 bps
Cable	Туре	Shielded
	Maximum length	15 m (49 ft)
5 Vdc power supply for RS-485		No

NOTE: The maximum baud rate for the serial link port depends on the protocol used.

RS-485 Characteristics

Characteristic		Description
Connector type		RJ45
Isolation		None
Maximum baud rate		115,200 bps
Cable Type		Shielded
	Maximum length	200 m (656 ft)
Polarization		Setting is required via software when connecting Multiple LTs. Refer to the "GP-Pro EX Device/PLC Manual" for the setting.
5 Vdc power supply for	RS-485	No

Pin Assignment

The figure shows the pins of the RJ45 connector when viewed from LT:



The table describes the pin assignment of the RJ45 connector:

Pin	RS-232C	RS-485	Description	
1	RxD	N.C.	Received data (RS-232C)	
2	TxD	N.C.	Transmitted data (RS-232C)	
3	N.C.	N.C.	Not connected	
4	N.C.	D1+	Differential data (RS-485)	
5	N.C.	D0-	Differential data (RS-485)	
6	RTS.	RTS	Ready to send	
7	N.C.	N.C.	Not connected	
8	GND	GND	Signal ground	

WARNING

UNINTENDED EQUIPMENT OPERATION

Do not connect wires to unused terminals or terminals marked "Not Connected (N.C.)".

Failure to follow these instructions can result in death, serious injury, or equipment damage.

Chapter 10 Specifications

Overview

This chapter presents the LT specifications.

What Is in This Chapter?

This chapter contains the following sections:

Section	Торіс	Page
10.1	General Specifications	128
10.2	Functional Specifications	130

Section 10.1

General Specifications

General Specifications

Electrical Specifications

The table shows the electrical specifications of LT:

Part Number	Rated Input Voltage	Input Voltage Limits	Acceptable Voltage Drop	Power Con- sump- tion	In-Rush Current	Voltage Endurance between power terminal and frame ground (FG)	Insulation Resistance between power terminal and FG
LT-4201TM (Modular Type DIO)	24 Vdc	2028.8 Vdc	10 ms or less at 20.4 Vdc	9 W or less	30 A or less at 28.8 Vdc	500 Vdc for 1 minute	10 MΩ or higher at 500 Vdc
LT-4201TM (Modular Type Analog)	24 Vdc	2028.8 Vdc	10 ms or less at 20.4 Vdc	12 W or less			
LT-4301TM (Modular Type DIO)	24 Vdc	2028.8 Vdc	10 ms or less at 20.4 Vdc	10 W or less			
LT-4301TM (Modular Type Analog)	24 Vdc	2028.8 Vdc	10 ms or less at 20.4 Vdc	13 W or less			

Environmental Specifications

The table shows the environmental specifications of LT:

	Characteristic	Specification		
	Vibration immunity (operating)	IEC 61131-2		
	Protection structure	NEMA TYPE 4X (indoors, with panel	embedded	
	Protection (front module)	IP65f - (IEC 60529)		
	Protection (rear module)	IP 20 - (IEC 60529)		
	Shock immunity (operating)	IEC 61131-2 15 gn 11 ms		
	Cooling method	Natural air circulation		
Environment	Weight	LT-4201TM (Modular Type DIO): 496 g (17.49 oz) LT-4301TM (Modular Type DIO): 531 g (18.73 oz) LT-4301TM (Modular Type DIO): 749 g (26.41 oz) LT-4201TM (Modular Type Analogous Type Analog		
īNir	Color	Front module: PT404 Rear module: RAL 7032		
Mechanical E	Material	front module: PC/PBT rear module: PC/PBT front module: PAALCE	front module: PC/PBT rear module: PC/PBT	
Mec		front module: PAA+GFrear module: PC/PBT	front module: PAA+GFrear module: PC/PBT	

Section 10.2

Functional Specifications

Overview

This section presents the LT functional specifications of the display, memory, and I/O.

What Is in This Section?

This section contains the following topics:

Торіс	Page
Display	131
Digital Inputs	132
Digital Outputs	134
Analog Inputs and Analog Outputs	136
Internal Circuits	140
Memory and Touch Panel	142

Display

Display Specifications

The table shows the display specifications of the LT:

Items	LT-4201TM	LT-4301TM	
	3.5 inch Display Module	5.7 inch Display Module	
Туре	TFT Color LCD	TFT Color LCD	
Resolution	320 x 240	320 x 240	
(pixels)	(QVGA)	(QVGA)	
Active display	70.56 x 52.92 mm	115.2 x 86.4 mm	
area (W x H)	(2.78 x 2.08 in.)	(4.53 x 3.40 in.)	
Display Colors	65536 colors	65536 colors	
Backlight	White LED	White LED	
	Non-exchangeable	Non-exchangeable	
	LED ON / OFF control, adjustable screen saver activation time	LED ON / OFF control, adjustable screen saver activation time	
Brightness adjustment	16 levels of adjustment available via touch panel in the configuration menu		
Language Fonts ⁽¹⁾	Japanese, ASCII, Chinese (Simplified), Chin	ese (Traditional), Korean, Cyrillic, Thai	
Character sizes	8 x 8, 8 x 16, 16 x 16 and 32 x 32 pixel fonts	8 x 8, 8 x 16, 16 x 16 and 32 x 32 pixel fonts	
Font sizes	Width can be expanded 18 times. Height can be expanded 1/2 and 18 times.	Width can be expanded 18 times. Height can be expanded 1/2 and 18 times.	
8 x 8 pixels	40 characters per row x 30 rows	40 characters per row x 30 rows	
8 x 16 pixels	40 characters per row x 15 rows	40 characters per row x 15 rows	
16 x 16 pixels	20 characters per row x 15 rows	20 characters per row x 15 rows	
32 x 32 pixels	10 characters per row x 7 rows 10 characters per row x 7 rows		
(1) Please refer t	the GP-Pro EX Reference Manual for detail	s on font types and character codes.	

Digital Inputs

Digital Input Characteristics

A WARNING

UNINTENDED EQUIPMENT OPERATION

Do not exceed any of the rated values specified.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

The table describes the characteristics of the digital inputs:

Characteristic		Value	
Rated current		5 mA	
Inrush values	Voltage	30 Vdc	
	Current	6.29 mA max.	
Input impedance		4.9 kΩ	
Input type		Sink/Source	
Rated voltage		24 Vdc	
Maximum Allowable Voltage)	28.8 Vdc	
Input limit values	ON Voltage	15 Vdc or more (1528.8 Vdc)	
	OFF Voltage	5 Vdc or less (05 Vdc)	
	ON Current	2.5 mA or more	
	OFF Current	1.0 mA or less	
Isolation	Method	Photo coupler Isolation	
	Between internal logic	500 Vdc	
Filtering		0.5 ms x N (N is 0 to 63)	
IEC61131-2 edition 3 type		Type 1	
Compatibility		Supports 2 wire and 3 wire sensors	
Cable type and length		Shielded: Maximum 100 m (328 ft) Non-shielded: 50 m (164 ft)	
Terminal blocks		Type: 3.5 mm (0.137 in.) pitch Terminal blocks are removable	
Input paralleling		No	

High-speed Counter Digital Input Characteristics

WARNING

UNINTENDED EQUIPMENT OPERATION

Do not exceed any of the rated values specified.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

The table describes the characteristics of the High-speed Counter and Pulse Catch inputs:

Characteristic		Value		
Rated current	Voltage	24 Vdc		
	Current	7.83 mA		
Inrush values	Voltage	30 Vdc		
	Current	9.99 mA		
Input impedance	I.	3.2 kΩ		
Input type		Sink/Source		
Rated voltage		24 Vdc		
Maximum Allowable Vo	Itage	28.8 Vdc		
Input limit values	ON Voltage	15 Vdc or more		
	OFF Voltage	5 Vdc or less		
	ON Current	5 mA or more		
	OFF Current	1.5 mA or less		
Isolation	Method	Photo coupler Isolation		
	Between internal logic	500 Vdc		
Filtering		None, 4 μs, 40 μs		
IEC61131-2 edition 3 ty	ре	Type 1		
Compatibility		Supports 2 wire and 3 wire sensors		
Cable	Туре	Shielded		
	Length	Maximum 10 m (33 ft)		
Terminal blocks		Type: 3.5 mm (0.137 in.) pitch Terminal blocks are removable		
Maximum frequency		 100 kHz is the maximum frequency for single-phase 50 kHz is the maximum frequency for 2 phase Duty Rate: 4555% 		
Phase Counting Mode		 Single-phase 2 Phase x2 2 Phase x4 2 Phase x2 Reverse 2 Phase x4 Reverse 		
Response time	Marker	1 ms		
	Preload	1 ms		
	Prestrobe	1 ms		
	Synchronize output	2 ms		
Min. Pulse Width (Pulse	e Input)	Counter Pulse Catch Input signal ON width ≥ 5 µs 5 µs 5 µs		
Input paralleling		No		

Digital Outputs

Transistor Output Characteristics

A WARNING

UNINTENDED EQUIPMENT OPERATION

Do not exceed any of the rated values specified.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

The table describes the characteristics of the transistor outputs:

Characteristic		Value	
Rated voltage		24 Vdc	
Output range		19.228.8 Vdc	
Output type		Sink/Source	
Rated current		0.3 A/point, 3.0 A/common	
Residual voltage		1.5 Vdc or less for I = 0.1 A	
Delay		Off to on (0.3 A load): 1.1 ms On to off (0.3 A load): 2 ms NOTE: The delay is not including the cable delay.	
Isolation	Method	Photo coupler Isolation	
	Between internal logic	500 Vdc	
Minimum resistor load		80 Ω at 24 Vdc	
Cable length		Non-shielded: 50 m (164 ft)	
Protection against short circuit		No	
Terminal blocks		Type: 3.5 mm (0.137 in.) pitch Terminal blocks are removable	
NOTE: Refer to Protecting O	utputs from Inductive L	oad Damage for additional information on this topic.	

Pulse Output/PWM Output/High-speed Counter (Synchronize Output) Characteristics

A WARNING

UNINTENDED EQUIPMENT OPERATION

Do not exceed any of the rated values specified.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

The table describes the characteristics of the Pulse Output/PWM Output/High-speed Counter (Synchronize Output):

Characteristic		Value		
Output type		Sink/Source		
Rated voltage		24 Vdc		
Power supply input range	e	19.228.8 Vdc		
Power supply reverse pr	otection	Yes		
Pulse output/PWM outpu	it current	50 mA/point, 100 mA/co	ommon	
Response time for origin	al input	2 ms		
Isolation resistance	Between fast outputs and internal logic	10 MΩ or more		
	Between power supply port and protective earth ground (PE) = 500 Vdc	10 M Ω or more		
Residual voltage	for I = 0, 1 A	1.5 Vdc or less		
Delay		Off to on (50 mA load): On to off (50 mA load): NOTE: The delay is not		
Minimum load impedanc	e	80 Ω		
Maximum Pulse output f	requency	50 KHz		
Maximum PWM output fi	equency	65 kHz		
Accuracy Pulse	Frequency	Accuracy	Duty	
Output/PWM Output	10100 Hz	0.1%	0100%	
	1011000 Hz	1%	199%	
	1.00120 kHz	5%	595%	
	20.00145 kHz	10%	1090%	
	45.00165 kHz	15%	1585%	
Duty rate range		199%		
Cable Type		Shielded, including 24 Vdc power supply		
Length		Maximum 5 m (16 ft)		
Terminal blocks		Type: 3.5 mm (0.137 in.) pitch Terminal blocks are removable		

Analog Inputs and Analog Outputs

Analog Input Characteristics

The table describes the characteristics of the analog inputs:

Characteristic		Voltage input	Current input
Number of maxin	num input channels	2	
Input type		Single-ended	
Input range		-10 10 Vdc/010 Vdc	020 mA/420 mA
Input impedance	te $1 \text{ M}\Omega \text{ or more}$ $250 \pm 0.11\% \Omega$		250 ± 0.11% Ω
Sample duration	time	10 ms per channel + 1 scan time	
Total input syster	m transfer time	20 ms + 1 scan time	
Input tolerance	Maximum deviation at 25° C (77° F) without electromagnetic disturbance	± 1% of the full scale	
	Maximum deviation	± 2.5% of the full scale	
Digital resolution		13 bits	
Temperature drift		± 0.06% of the full scale	
Common mode characteristics 80 db			
Cross talk		60 db	
Non-linearity		± 0.4% of full scale	
Input value of LS	В	5 mV 10 μA	
Maximum allowed damages)	d overload (no	(no ± 30 Vdc (less than 5 minutes) ± 15 Vdc (No damage) ± 30 mA dc	
Protection type		Photo coupler between input and internal circuit	
Cable	Туре	Shielded	
	Length	Must be less than 3 m for IEC61131-2 conformance. Maximum transmission distance is 10 m.	
Terminal blocks Type: 3.5 mm (0.137 in.) pitch Terminal blocks are removable			
Isolation		External input: Photo coupler isolation Between channels: Non-isolated	

Temperature Input (Temperature Probes) Characteristics

A WARNING

UNINTENDED EQUIPMENT OPERATION

Do not exceed any of the rated values specified.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

The table describes the characteristics of the Temperature Input (Temperature Probes):

Input impedance Sample duration time Wiring type Conversion mode Input filter Resolution temperature value Detection type	00/Ni100 000/Ni1000	$ Pt100/Pt1000/Ni1000/Ni1000 \\ Pt100/Pt1000: -200600° C (-3281112° F) \\ Ni100/Ni1000: -20200° C (-4392° F) \\ 1.12 mA \pm 3.5% \\ 0.242 μA \pm 3.5% \\ Typically 10 MΩ \\ 10 ms+1 cycle time \\ 2-wire or 3-wire connection configured by software for all inputs$	
Measuring current Pt10 Pt10 Input impedance Sample duration time Wiring type Conversion mode Input filter Resolution temperature value Detection type		Ni100/Ni1000: -20200° C (-4392° F) $1.12 \text{ mA} \pm 3.5\%$ $0.242 \text{ µA} \pm 3.5\%$ Typically 10 M Ω 10 ms+1 cycle time 2-wire or 3-wire connection configured by software for all inputs	
Input impedance Sample duration time Wiring type Conversion mode Input filter Resolution temperature value Detection type		0.242 μ A \pm 3.5% Typically 10 M Ω 10 ms+1 cycle time 2-wire or 3-wire connection configured by software for all inputs	
Input impedance Sample duration time Wiring type Conversion mode Input filter Resolution temperature value Detection type	000/Ni1000	Typically 10 M Ω 10 ms+1 cycle time 2-wire or 3-wire connection configured by software for all inputs	
Sample duration time Wiring type Conversion mode Input filter Resolution temperature value Detection type		10 ms+1 cycle time 2-wire or 3-wire connection configured by software for all inputs	
Wiring type Conversion mode Input filter Resolution temperature value Detection type		2-wire or 3-wire connection configured by software for all inputs	
Conversion mode Input filter Resolution temperature value Detection type		for all inputs	
Input filter Resolution temperature value Detection type		61 1 11 1	
Resolution temperature value Detection type		Sigma delta type	
Detection type		Low pass	
	alue	0.1°C (0.18°F)	
Input tolerance* Max	Detection type Open circuit (detection on each channel)		
(77° elec	ximum riation at 25° C ° F) without ctromagnetic urbance	± 5° C (41° F)	
dev 25	ximum riation at 50° C 122° F)	Pt type: ± 5.6° C (42.08° F) Ni type: ± 5.2° C (41.36° F)	
Temperature drift		30 ppm/° C	
Digital resolution		16 bits	
Rejection in 50/6 differential mode	60 Hz	Typically 60 dB	
Common mode rejection		Typically 80 dB	
Isolation method		Photo coupler Isolation	
Permitted input signal	input signal ±5 Vdc max.		
Cable length Pt1	00/Ni100	20 Ω or less	
Pt1	000/Ni1000	200 Ω or less	
Terminal blocks		Type: 3.5 mm (0.137 in.) pitch Terminal blocks are removable	
Noise resistance - cable			
* Excluding errors caused		Shielded cable is necessary	

Temperature Input (Thermocouple) Characteristics

A WARNING

UNINTENDED EQUIPMENT OPERATION

Do not exceed any of the rated values specified.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

The table describes the characteristics of the Temperature Input (Thermocouple):

Input Characteristics			
Input sensor type		Thermocouple	
Input type range (1)		J (-200760° C) (-3281400° F) K (-2401370° C) (-4002498° F) R (01600° C) (322912° F) B (2001800° C) (3923272° F) S (0° C1600° C) (322912° F) T (-200400° C) (-328752° F) E (-200900° C) (-3281652° F) N (-2001300° C) (-3282372° F)	
Input impedance		Typically 10 MΩ	
Sample duration time		10 ms+1 cycle time	
Conversion mode		Sigma delta type	
Digital resolution		16 bits	
Input filter		Low pass	
Resolution temperature value		0.1°C (0.18°F) (Type J)	
Detection type		Open circuit (detection on each channel)	
Input tolerance	Maximum deviation at 25° C (77° F) without electromagnetic disturbance	0.2 % of the full scale, plus standard point of compensation precision at +/- 6 $^{\circ}$ C.	
	Maximum deviation	0.28% of full scale range	
Temperature drift		30 ppm/° C	
Input tolerance - term compensation	ninal temperature	± 5° C (41° F) after 10 min.	
Cold junction compensation in the temperature range (050° C (122° F))		Internal cold junction error: +/- 6° C (42.8° F) after operating 45 minutes.	
Rejection in differential mode	50/60 Hz	Typically 60 dB	
Common mode rejection		Typically 80 dB	
Isolation method		Photo coupler isolation	
Permitted input signa	l	± 5 Vdc max.	
Warm up time		45 minutes	
Terminal blocks		Type: 3.5 mm (0.137 in.) pitch Terminal blocks are removable	
Noise resistance - cable		Shielded cable is necessary	
(1) Temperature mea	asurement on PCB at terminal	block for cold junction compensation.	

Analog Output Characteristics

A WARNING

UNINTENDED EQUIPMENT OPERATION

Do not exceed any of the rated values specified.

Failure to follow these instructions can result in death, serious injury, or equipment damage.

The table describes the characteristics of the analog outputs:


Characteristic		Voltage Output	Current Output	
Maximum number of	f outputs	2		
Output range		-10 10 Vdc/010 Vdc	020 mA / 420 mA	
Load impedance		$2 \text{ k}\Omega$ or more	300 Ω or less	
Application load type)	Resistive load		
Settling time		10 ms		
Total output system	transfer time	10 ms + 1 scan time		
Output tolerance	Maximum deviation at 25° C (77° F) without electromagnetic disturbance	deviation at 25° C (77° F) without electromagnetic		
	Maximum deviation	± 2.5% of the full scale		
Digital resolution		12 bits	12 bits	
Temperature drift		± 0.06% of the full scale		
Output ripple		± 50 mV		
Cross talk		60 db		
Non-linearity		± 0.5% of the full scale		
Output value of LSB		6 mV 12 μA		
Protection type Photo coupler between input and internal of		t and internal circuit		
Output protection		Short circuit protection: Yes Open circuit protection: Yes		
Output behavior if in is less than the power		Set to 0		
Cable	Туре	Shielded		
	Length	Must be less than 3 m for IE conformance. Maximum trar 10 m.		
Terminal blocks		Type: 3.5 mm (0.137 in.) pitch Terminal blocks are removable		
Isolation		External input: Photo coupler isolation Between channels: Non-isolated		

Internal Circuits


LT-4201TM/4301TM (Modular Type DIO) Internal Circuit

Terminal Blocks

The circuit configuration of I0, I1 is shown as follows:





The circuit configuration from I2 to I19 is shown as follows:



It is source type


The circuit configuration of Q0 and Q1 is shown as follows: The circuit configuration from Q2 to Q11 is shown as follows: It is source type






It is sink type

The circuit configuration of Q0 and Q1 is shown as follows: The circuit configuration from Q2 to Q11 is shown as follows: It is sink type







LT-4201TM/4301TM (Modular Type Analog) Internal Circuit

Terminal Blocks


The circuit configuration of I0, I1 is shown as follows:





The circuit configuration from I2 to I11 is shown as follows:



It is source type









It is sink type

The circuit configuration of Q0 and Q1 is shown as follows: The circuit configuration from Q2 to Q7 is shown as follows: It is sink type





Memory and Touch Panel

Memory

The table shows the memory specifications of LT:

Items	Specification
Application memory ⁽¹⁾	FLASH EPROM 16 MB (Includes screen editing program and extended logic program))
Logic program area	FLASH EPROM 132 KB ⁽²⁾ (equivalent to 15,000 steps)
Front area	FLASH EPROM 8 MB (when limit exceeded, uses application memory)
Data backup	nvSRAM 128 KB
Variable area	nvSRAM 64 KB
(1) Capacity available for user application. (2) Up to 60,000 steps can be converted in software. However, this reduces application memorapacity (for screen data) by 1 MB	

Data Back-Up Management

This memory saves data even when the LT is turned OFF. Upon user request, the setting can be changed through software application.

Touch Panel

The table shows the touch-panel specifications of LT:

Items	Specification
Туре	Resistive film (analog)
Lifetime	1 million touches or more

Chapter 11 Maintenance

Overview

This chapter explains how to maintain your LT units.

What Is in This Chapter?

This chapter contains the following topics:

Topic	Page
Regular Cleaning	144
Periodic Check Points	145

Regular Cleaning

Cleaning the Display

NOTICE

EQUIPMENT DAMAGE

- Power off the unit before cleaning it.
- Do not use hard or pointed objects to operate the touch panel since it can damage the panel surface.
- Do not use paint thinner, organic solvents, or a strong acid compound to clean the unit.

Failure to follow these instructions can result in equipment damage.

When the surface or the frame of the display gets dirty, soak a soft cloth in water with a neutral detergent, wring the cloth tightly, and wipe the display.

Periodic Check Points

Operation Environment

Refer to the Environmental Specifications (see page 30).

Electrical Specifications

The input voltage must be within 20.4 to 28.8 Vdc.

Related Items

- Are all power cords and cables connected properly? Are there any loose cables?
- Are all display installation nuts holding the unit securely?